

Project No. 8528-1SHPK

ADDENDUM NUMBER 01

RENOVATION OF SHERIDAN PARK PAVILION
4800 South Lake Drive
Cudahy, Wisconsin 53110

Project Number: 8528-1SHPK

Date of Addendum: 6/16/2014

This Addendum to the Contract Documents is issued to modify, explain or correct the original documents, dated 6/4/2014, and is hereby made part of the Contract Documents. Acknowledge receipt of this Addendum in the space provided on the Bid Form, or bid may be rejected.

SPECIFICATIONS

Specification Section 06 20 13 – Exterior Finish Carpentry

ADD Line 4 to 1.2 SUMMARY, paragraph A as follows:

4. **Exterior fiber cement lap siding, trim and accessories.**

ADD Article 1.2 FIBER-CEMENT PANELS, as follows:

2.5 FIBER-CEMENT PANELS

- A. General: Non-asbestos fiber-cement plank siding to comply with ASTM C 1186, Type A, Grade II, noncombustible when tested according to ASTM E 136; with a flame-spread index of 25 or less when tested according to ASTM E 84.**
 1. **Basis-of-Design Product: Subject to compliance with requirements, provide Hardi-Plank Select Cedarmill HZ5 lap siding or comparable product by one of the following:**
 - a. **James Hardie.**
 - b. **Certainteed**
 - c. **Or approved equal**
- B. Lap Siding: Plank lap siding with sloped top, beveled drip edge and nailing line.**
 1. **Type: Simulated wood grain face 5-1/4 inches with 4 inches exposure.**
- C. Factory Priming: Manufacturer's standard acrylic primer tinted to match final paint as scheduled.**

ADD paragraph to Article E. 3.2 PREPARATION, as follows:

- C. Install a water-resistive barrier is required in accordance with local building code requirements.**

ADD paragraph to Article E. 3.3 INSTALLATION, GENERAL, as follows:

- D. Fiber-cement lap siding installation:**

4. **Install materials in strict accordance with manufacturer's installation instructions.**
5. **Starting: Install a minimum 1/4 inch thick lath starter strip at the bottom course of the wall. Apply planks horizontally with minimum 1-1/4 inches wide laps at the top. The bottom edge of the first plank overlaps the starter strip.**
6. **Allow minimum vertical clearance between the edge of siding and any other material in strict accordance with the manufacturer's installation instructions.**
7. **Align vertical joints of the planks over framing members.**
8. **Maintain clearance between siding and adjacent finished grade.**
9. **Locate splices at least one stud cavity away from window and door openings.**
10. **Locate splices at least 12 inches away from window and door openings.**

Specification Section 08 16 13 – Fiberglass Doors and Sidelights

CHANGE Articles 2.1 to 2.5 as follows:

2. 1 MANUFACTURER

- A. Basis of Design: Doors are based on the Pella Architect Series fiberglass pre-hung entry door. Pella Corporation, 102 Main Street, Pella, Iowa 50219. Toll Free (800) 54-PELLA. Website www.pella.com.**
 1. **Door Design: 1/2 panel Architect Series Outswing Door with simulated divided light: factory assembled installed in clad wood frame.**
 2. **Sidelight Design: 1/2 panel Architect Series with simulated divided light; factory assembled installed in clad wood frame.**
- B. Other manufacturers that may be used if conforming with the requirements:**
 1. Anderson Corporation.
 2. **Jeld-Wen.**
 3. Substitutions per the requirements of Section 01600 Product Requirements.

2. 2 MATERIALS

- A. Fiberglass Skins: 0.072-inch minimum fiberglass skin on exterior and interior surfaces with CFC-free injected foam insulating core.**
- B. Stiles and Rails: Wood top rails and stiles and wood plastic composite bottom rails secured with structural adhesive between skins at perimeter.**
- C. Clad Frame: Extruded aluminum with baked polyester finish.**
 1. **Finish Color: White.**

2. 3 FIBERGLASS ENTRANCE DOORS AND SIDELIGHTS

- A. Thickness: 1-11/16 inch.**
- B. Door Style: Panel and Glass.**
- C. Door Shape: Squared Top.**
- D. Sidelight Shape: Squared Top.**
 1. **Panels per Face: One.**

E. Finish

1. **Fiberglass Grain: Smooth.**
2. Paint Surface.
 - a. **Color: White.**

F. Hardware: Pre-hung hinges. Prep door for owner supplied lockset.

G. Weather Strip:

1. **Manufacturer's standard head, jamb and sill weather strip.**

H. Reinforcement: Solid reinforcement positioned to support surface-mounted closer by door hardware supplier.

2.4 PREHUNG HARDWOOD SYSTEMS

A. Profile: **Architect Series, 1/2 light.**

B. Frames:

1. **Interior Exposed Surfaces: Clear pine, veneered, and edge banded; primed ready for site finishing with no visible fastener holes.**
2. **Exterior Surfaces: Aluminum clad wood.**
3. **Overall Frame Depth: 5-5-16".**
4. **Sill: Extruded aluminum sill with mill finish; ADA sill height.**

C. Hinges: **Stainless steel concealed-bearing and non-removal pin..**

1. Size: 4 by 4 or 4.5 by 4.5 square.
2. **Finish: US32D, stainless steel.**

D. Sills: Aluminum with Anodized Aluminum Finish.

E. Glass Insert Style: Low E, argon filled insulated tempered glazing with 9 simulated divided lites: between the glass muntins with fixed applied **1-1/4-inch** muntins at interior and exterior surfaces.

1. **Finish: To match door panel.**

Specification Section 08 52 13 – Clad Wood Windows

CHANGE Article 2.3 as follows:

2.3 WOOD WINDOWS

- A. Operating Types: Provide the following operating types in locations indicated on Drawings:
1. Double hung (**Eagle Talon: Basis of Design**).

ADD Paragraph 2.3 B as follows:

- B. Fixed Types: Provide the following fixed types in locations indicated on Drawings:**
4. **Fixed Window: (Eagle Clad Auxiliary: Basis of Design).**

Specification Section 09 91 13 – Exterior Painting

CHANGE 3.6 EXTERIOR PAINTING SCHEDULE, paragraph D as follows:

- C. Fiber-Cement Substrates: Including pre-primed fiber-cement trim and panel siding.
- 4. **Acrylic** System:
 - a. Prime Coat at Cut Ends: Primer, **Alkali-resistant primer** for exterior wood **or as recommended by siding manufacturer.**
 - b. First/Intermediate Coat: Exterior **100 percent acrylic** matching topcoat.
 - c. Topcoat: Acrylic, exterior, semi-gloss (Gloss Level 5).

Specification Section 23 33 00 – Air Duct Accessories

CHANGE 2.11 LOUVERS, as follows:

- 1. Delete line A. ~~“Louvers are specified in the architectural section of these Specifications.”~~

DRAWINGS

SHEET A1.1

- 1. **Add** wall tags at the north wall of MENS 101 and WOMENS 102 to indicate Wall Type 5-SIM. See attached drawing A1.1-1.
- 2. **Add** note to indicate patching at the location of the removed louver between MECANICAL 108 and STORAGE 107 and general patching for STORAGE 107. See attached drawing A1.1-2.
- 3. **Revise** Demolition Note 9 to read: ABATEMENT CONTRACTOR TO REMOVE ALL WINDOWS SCHEDULE FOR REMOVAL UNDER SEPARATE CONTRACT. GENERAL CONTRACTOR TO COORDINATE SCHEDULING.
- 4. **Add** Demolition Note 28: REMOVE EXISTING LOUVER. See attached drawing A1.1-2.
- 5. **Add** Demolition Note 29: REMOVE ALL EXISTING GUTTERS AND DOWNSPOUTS. TURN OVER COPPER GUTTERS TO OWNER.
- 6. **Revise** refrigerator clearance size to be 2'-6". Coordinate with the Owner on the size of the refrigerator. See attached drawing A1.1-2.

SHEET A1.2

- 1. **Remove** new air intake note from roof. See attached drawing A1.2-1.
- 2. **Revise** note on Condenser Cage to read: PROVIDE PROPERTY ARMOR P3 BRAWLER FLIP OVER CONDENSER CAGE OR EQUAL. SECURE CAGE TO PAD PER MANUFACTURES SPECIFICATIONS. COORDINATE WITH METAL JACKETING TO PROTECT EXTERIOR REFRIGERANT LINES. SEE MECHANICAL DRAWINGS FOR SIZE OF CONDENSERS. See attached drawing A1.2-1.
- 3. **Add** a new ridge vent to each of the existing ridges as part of the re-roofing.

SHEET A2.1

- 1. **Revise** detail tag to read 16/A4.1. See attached drawing A2.1-1.
- 2. **Add** detail tag at Alternate A overhang. See attached drawing A2.1-1.

SHEET A3.1

- 1. **Add** wall louvers at east and west gable ends. Coordinate louver size with Mechanical Drawings. See attached drawing A3.1-1.
- 2. **Add** typical note reference for Contractor to coordinate with Owner for the installation of rain barrels at downspout locations. See attached drawing A3.1-2.
- 3. **Add** typical note reference to include splash blocks at downspout locations. See attached

- drawing A3.1-2.
4. **Add** typical note to coordinate overhang downspout installation with light locations. See attached drawing A3.1-2.
 5. **Add** note at west, east, and south end gables "Existing vinyl siding to remain." See attached drawing A3.1-2.
 6. **Revise** North and South elevations to reflect new door details. See attached drawings A3.1-3 and A3.1-3.
 7. **Revise** west elevation to remove the brick infill at the north louver to accommodate a new mechanical louver in the same opening. See attached drawing A3.1-4.
 8. **Add** condenser and security cage to north and south elevations. See attached drawing A3.1-5.

SHEET A4.1

1. **Add** window details. See attached drawings A4.1-1, A4.1-2, A4.1-3, A4.1-4, A4.1-5, A4.2-1, A4.2-2, A4.2-3, A4.2-4, A4.2-5, A4.2-6, A4.2-7, A4.2-8, A4.2-9, A4.2-10
2. **Add** entry door details. See attached drawings A4.1-6, A4.1-7, A4.1-8, A4.1-9
3. **Revise** Detail 4A/A4.1 and 16/A4.1 to show the continuous drip edge to lap fascia board by least 1".
4. **Revise** all references to Prefinished Cement Board siding to be Pre-Primed Cement Board Siding.
5. **Revise** details 2/A4.1 and 3/A4.1 to alter the soffit and new door conditions. See attached drawings A4.1-9 and A4.1-10.

SHEET A5.1

1. **Revise** CB-2 to be Cement Lap Board Siding. See attached drawing A5.1-1.
2. **Revise** hardware schedule. See attached drawing A5.1-1.
3. **Revise** Door D1 and Frame F-2. See attached drawing A5.1-2

SHEET H0.1

1. **Delete** Details 2 & 3.

SHEET H1.0

1. **Delete** Outside Air and Relief Air Roof Hoods. See attached drawings H1 and H2.
2. **Revise** Keyed Notes #17 and #27 to provide Outside Air and Relief Air Louvers. See attached drawings H1, H2, and H3.
3. **Delete** 10x5 louver for Combustion Air. See attached drawing H2.
4. **Revise** Keyed Note #22 to provide 16"x16" Louver. See attached drawings H1 and H2.
5. **Delete** 5" diameter Combustion Air Intake through roof, see revised Keyed Note #19 drawing H2.
6. **Add** louver schedule with L-1, L-2 & L-3. See drawing H3.

SHEET E1.1

1. **Revise** Plan note #2. See attached drawing E1.

SHEET E2.1

1. **Revise** Plan note #3. See attached drawing E2.

End of Addendum No. 1

Attachments:

Sign-in sheet from pre-bid conference – 2014-06-18

MILWAUKEE COUNTY
Dept. of Administrative Services
Sign-In Sheet



PRE-BID MEETING

DATE: June 18, 2014 at 10:30 a.m. PLACE: 4800 S. Lake Dr., Cudahy, WI


PROJECT: SHERIDAN PARK PAVILION/SKATE SHELTER RENOVATION


PROJECT NO. 8528-1SHPK

NAME	ORGANIZATION	PHONE	MOBILE	EMAIL
Nike Spanhemer	Burdurat	262 783-4333		Nike@burduratconstruction.com
John Sackerson	Sackerson	414-769-6066		sackerson@sackerson.com
Mary Komjath	INTEC	414-732-2294		mary@intecwi.com
Kevin Kwo	TRIAD	414-258-7111		kk@triadgc.com
Rick Fortmann	INDUSTRIAL PROTECTIVE COATINGS	262-490-8255		R.FORTMANN@ANCHORSOND.COM
BRADY COATES	COATES FLEM	262-798-9500		BRADY@COATESFLEM.COM
TOOD RASMUSSEN	AFFORDABLE HEATING	414-491-3727		TOOD@AFFORDABLEHTG.COM
Jill Organ	MC Parks	414/257-4772	414/333-7578	jill.organ@milwaukee-countywi.gov
ALI KOPYT	Quorum	(414) 265 9265		ali@quorumarchitects.com
BRIAN SCOTT	"	"		brian@quorumarchitects.com

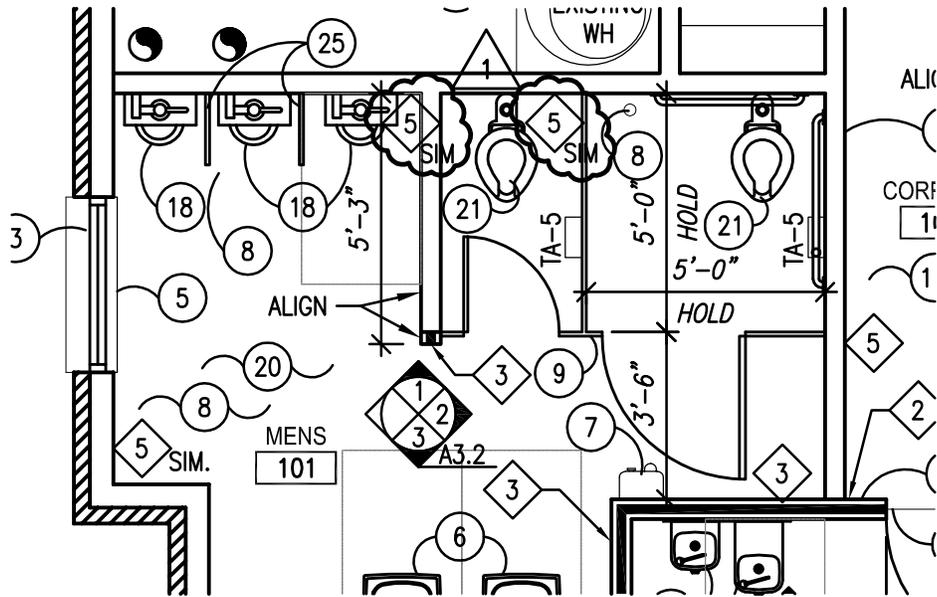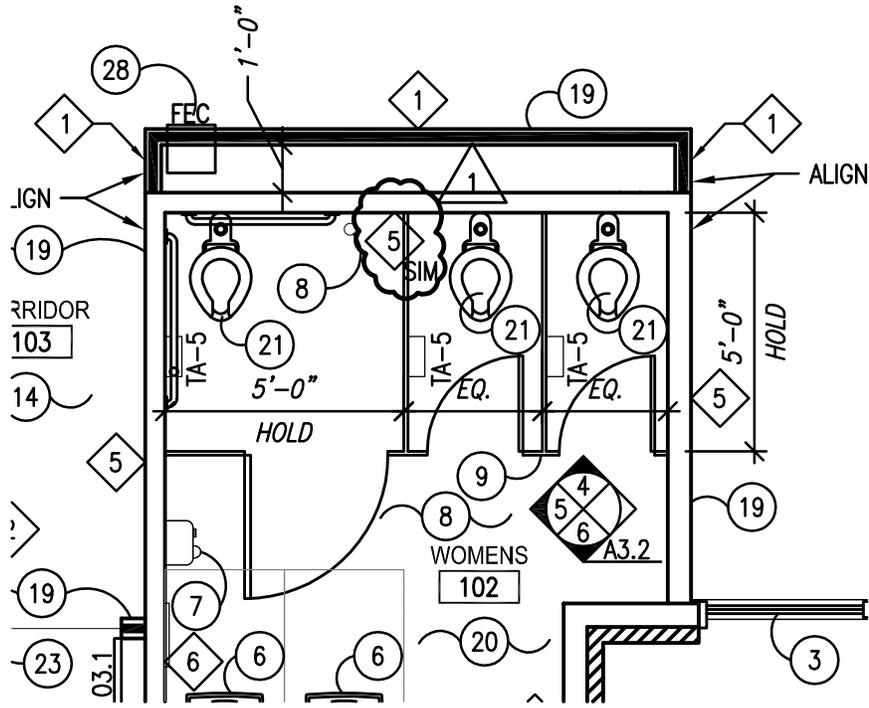


2 CONSTRUCTION PLAN
SCALE: 1/4" = 1'-0"



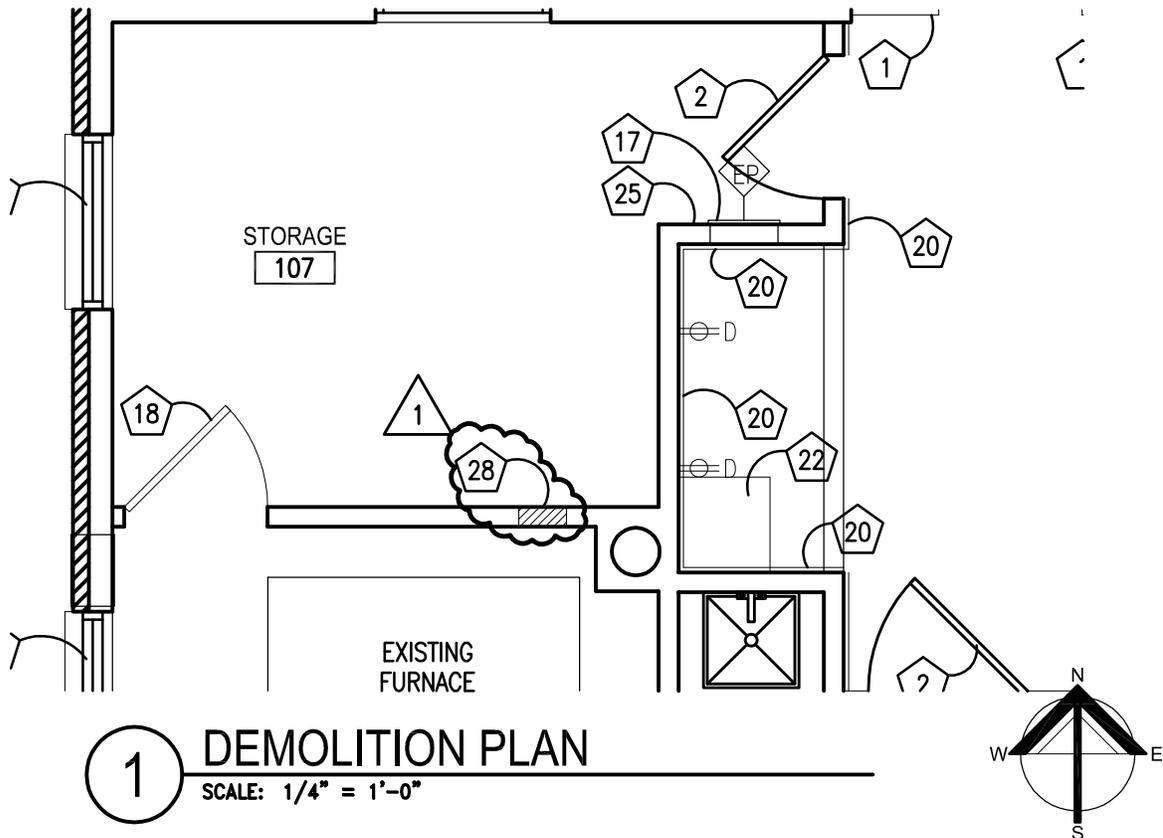


1 DEMOLITION PLAN
SCALE: 1/4" = 1'-0"

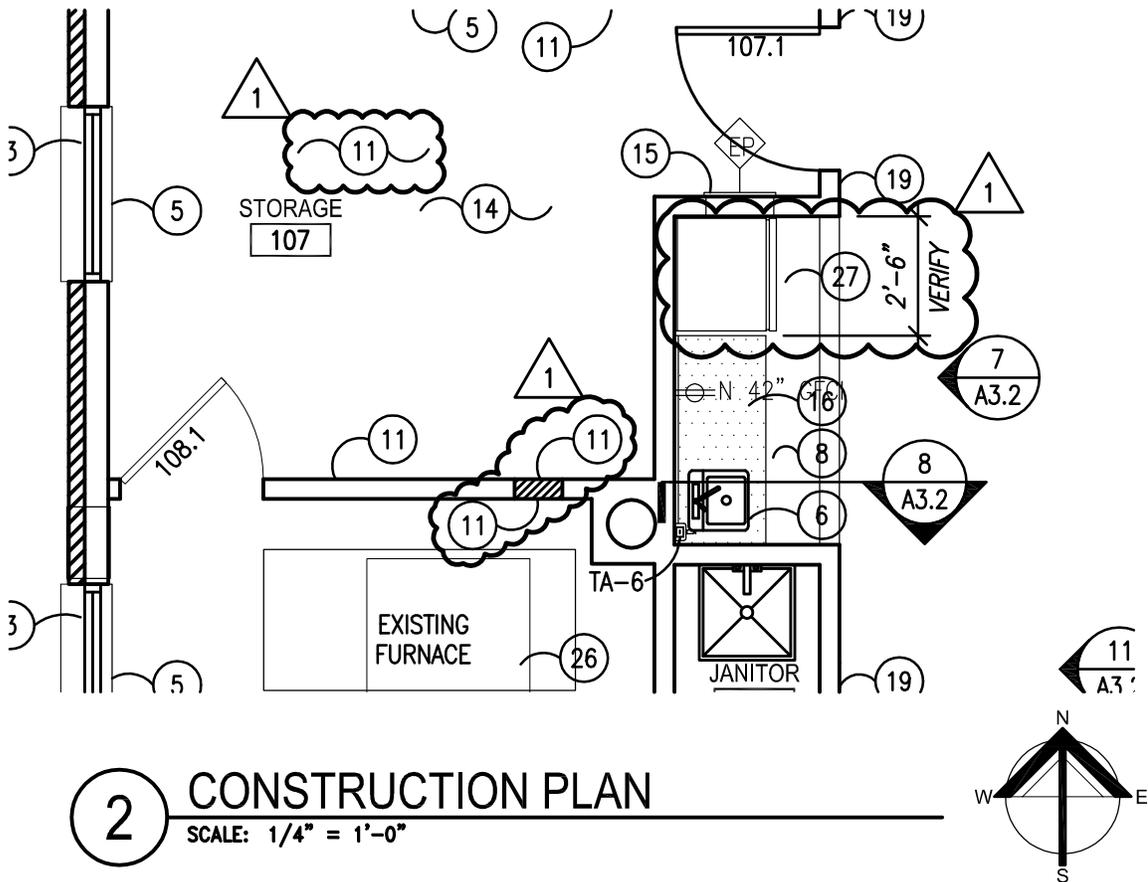


2 CONSTRUCTION PLAN
SCALE: 1/4" = 1'-0"



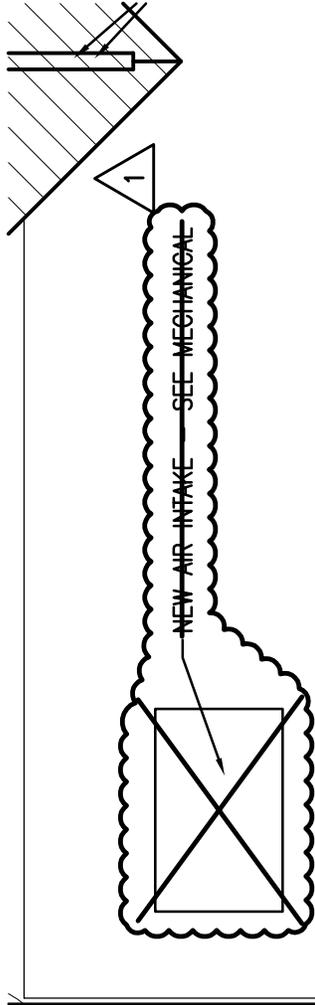

PROVIDE PROPERTY ARMOR P3 BRAWLER
 FLIP OVER CONDENSER CAGE OR EQUAL.
 SECURE CAGE TO PAD PER MANUFACTURES
 SPECIFICATIONS. COORDINATE WITH METAL
 JACKETING TO PROTECT EXTERIOR
 REFRIGERANT LINES. SEE MECHANICAL
 DRAWINGS FOR SIZE OF CONDENSERS


4" CONCRETE SLAB ON 6"
 COMPACTED CRUSHED STONE BASE



EXISTING ROOF
 VENT

PITCH

PITCH



1 ROOF PLAN

SCALE: 1/4" = 1'-0"





Milwaukee County Dept. of Administrative Services
 FACILITIES MANAGEMENT DIVISION
 Architectural, Engineering & Environmental Services
 CITY CAMPUS 2711 W. WELLS ST., 2ND FLOOR MILWAUKEE, WI 53208




Renovation of
SHERIDAN PARK PAVILION
 4800 South Lake Drive, Cudahy, Wisconsin 53110

REF. SHEET: A1.1
 DRAWING: A1.2-1

DATE: 06/16/2014
 PROJECT: 8528-1SHPK
 QUORUM - 14001.01
 ADDENDUM: 01

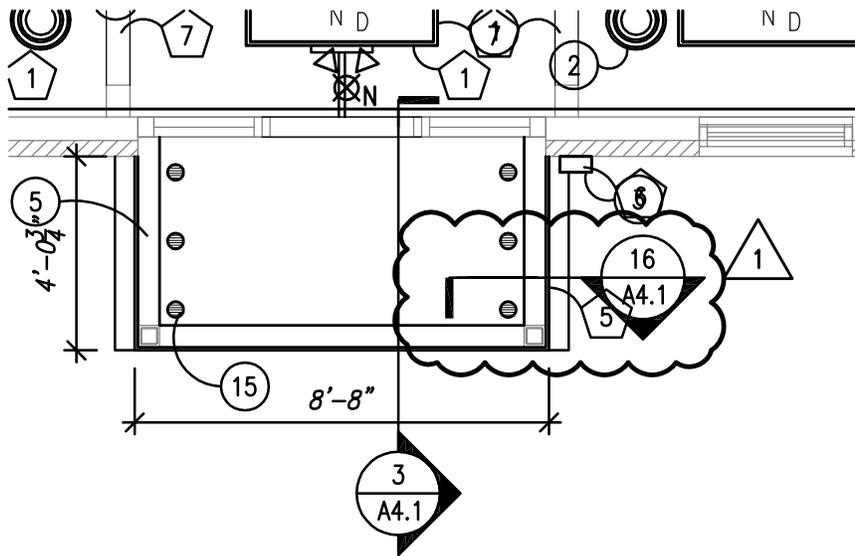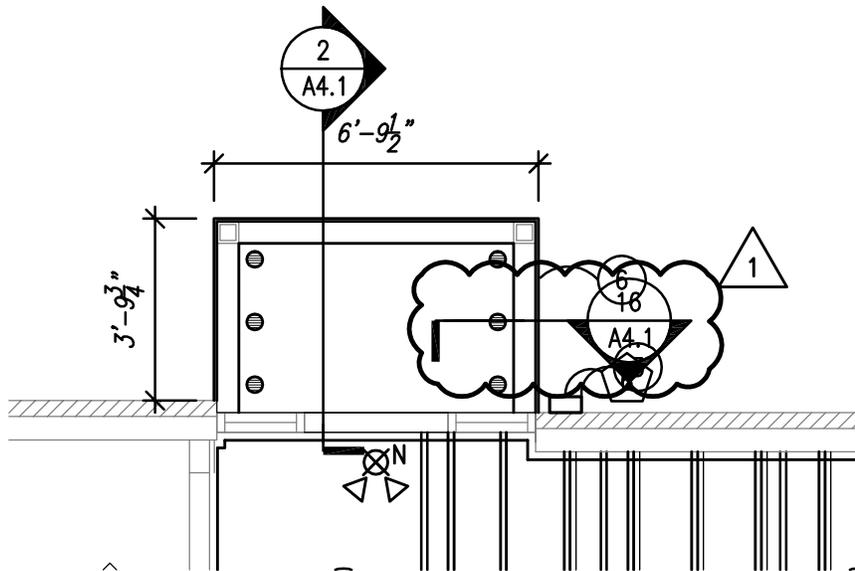

2 REFLECTED CEILING CONSTRUCTION PLAN
 SCALE: 1/4" = 1'-0"




REF. SHEET:
A2.1
DRAWING:
A2.1-1


DATE:
06/16/2014
PROJECT:
8528-1SHPK
QUORUM - 14001.01

ADDENDUM: 01



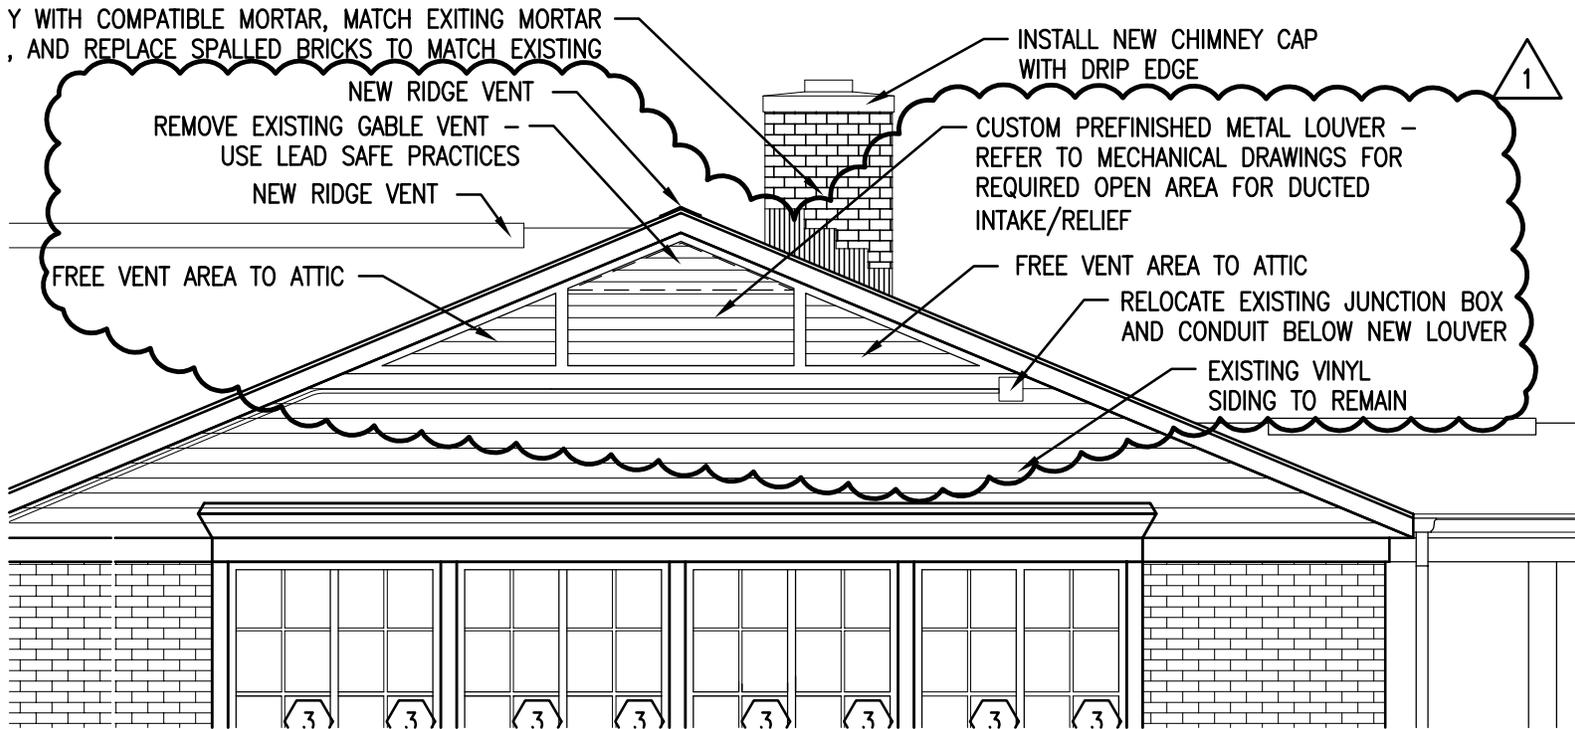

2 EAST ELEVATION
SCALE: 1/4" = 1'-0"

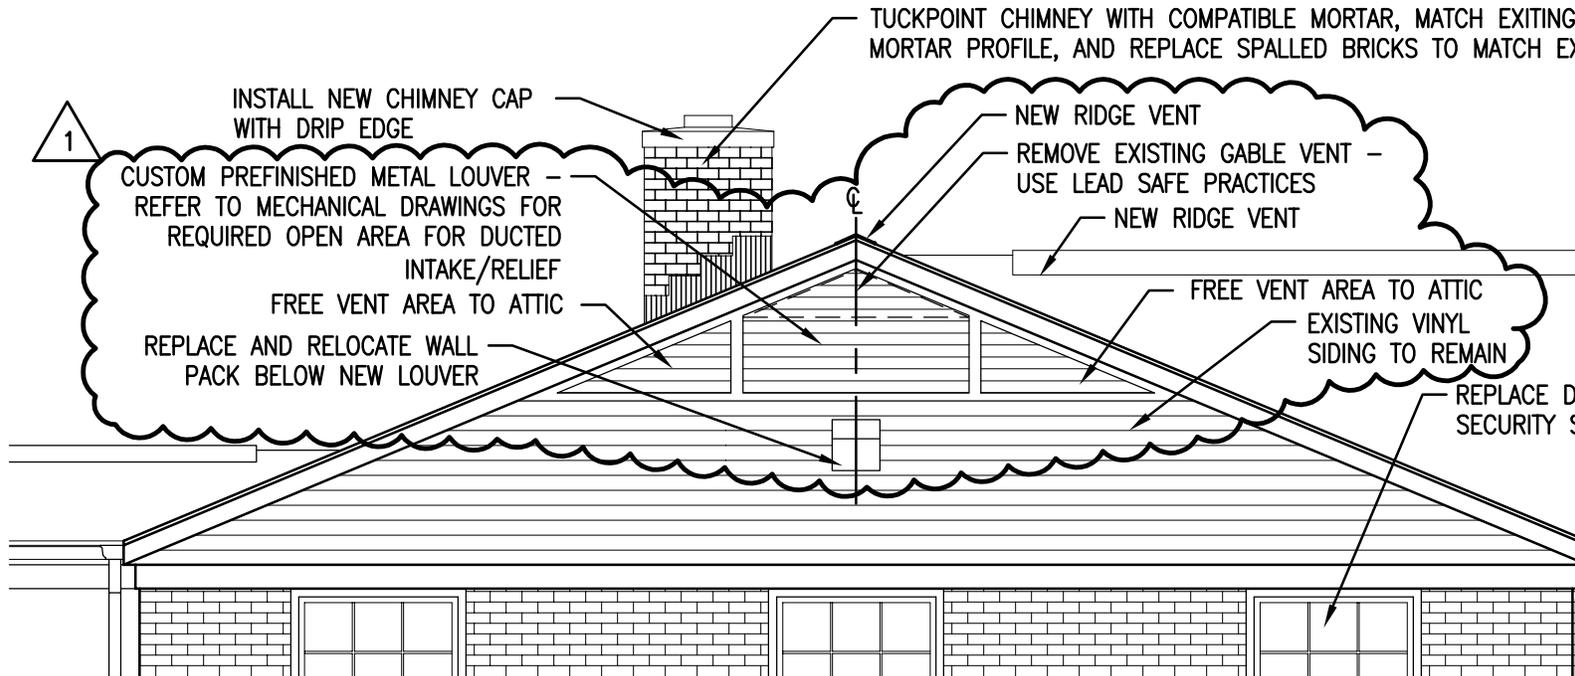


4 WEST ELEVATION
SCALE: 1/4" = 1'-0"

REF. SHEET:
A3.1
DRAWING:
A3.1-1

DATE:
06/16/2014
PROJECT:
8528-1SHPK
QUORUM - 14001.01

ADDENDUM: 01



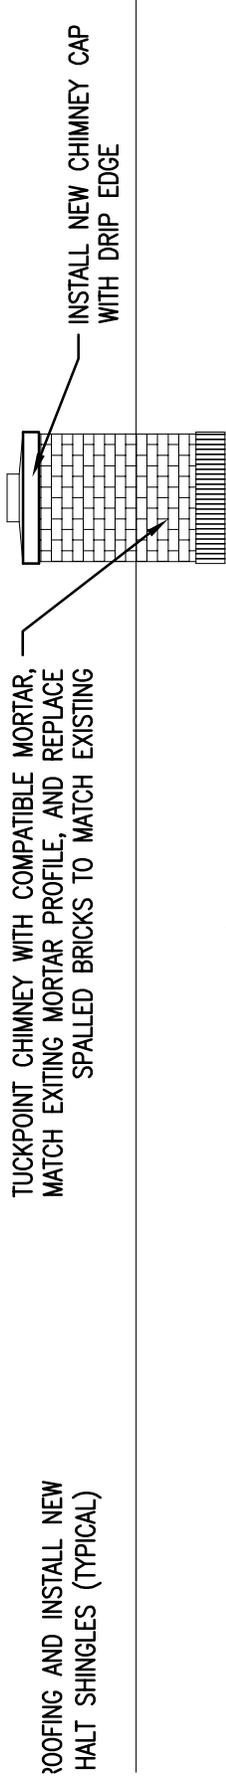

3 NORTH ELEVATION
SCALE: 1/4" = 1'-0"


REF. SHEET: A3.1
DRAWING: A3.1-2
DATE: 06/16/2014
PROJECT: 8528-1SHPK
QUORUM - 14001.01
ADDENDUM: 01



Milwaukee County Dept. of Administrative Services
FACILITIES MANAGEMENT DIVISION
Architectural, Engineering & Environmental Services
CITY CAMPUS 2711 W. WELLS ST., 2ND FLOOR MILWAUKEE, WI 53208



Renovation of
SHERIDAN PARK PAVILION
4800 South Lake Drive, Cudahy, Wisconsin 53110

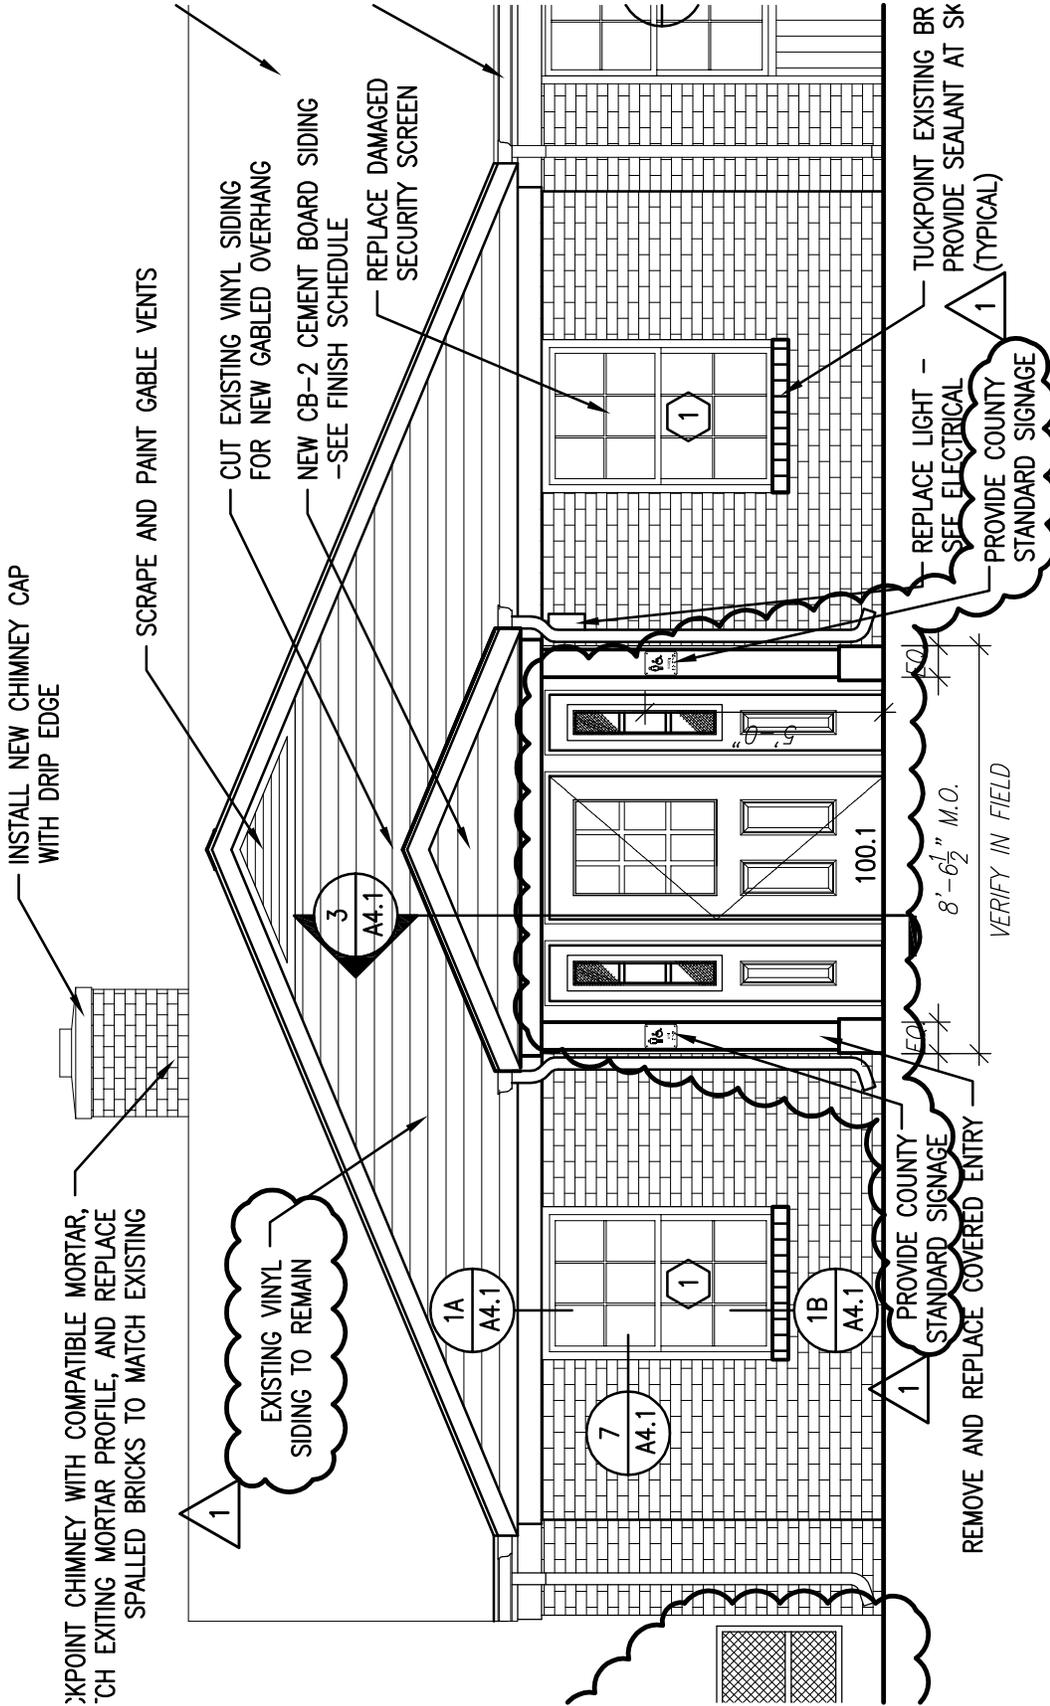


1 SOUTH ELEVATION
 SCALE: 1/4" = 1'-0"

REF. SHEET: A3.1
 DRAWING: A3.1-3
 DATE: 06/16/2014
 PROJECT: 8528-1SHPK
 QUORUM - 14001.01
 ADDENDUM: 01

Milwaukee County Dept. of Administrative Services
 FACILITIES MANAGEMENT DIVISION
 Architectural, Engineering & Environmental Services
 CITY CAMPUS 2711 W. WELLS ST., 2ND FLOOR MILWAUKEE, WI 53208





Renovation of
SHERIDAN PARK PAVILION
 4800 South Lake Drive, Cudahy, Wisconsin 53110

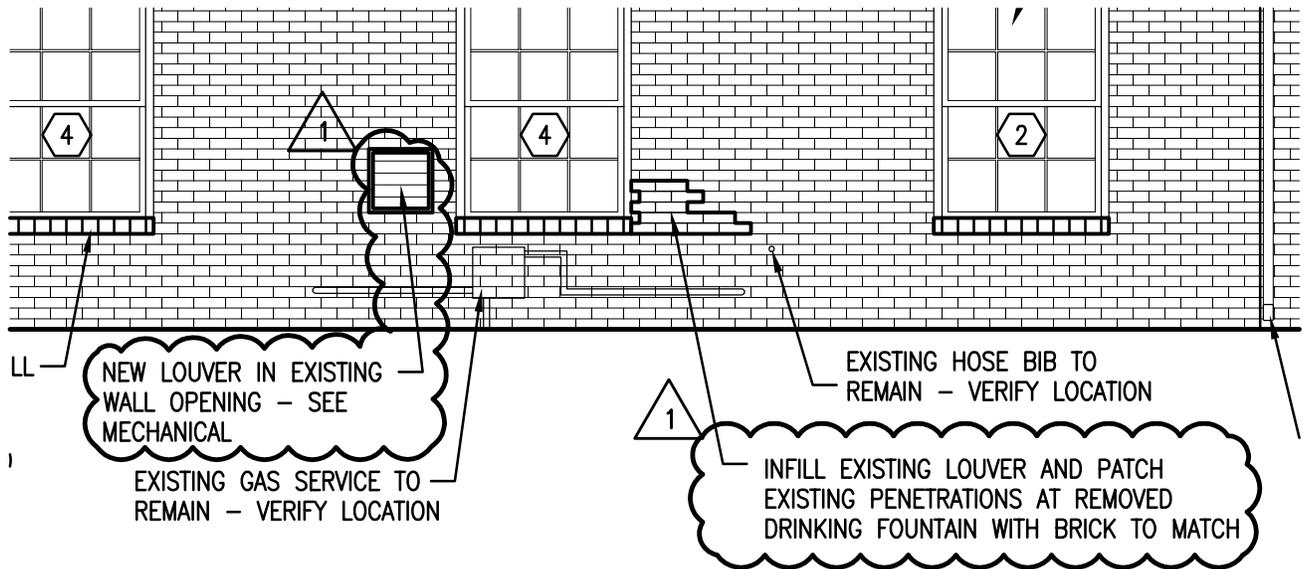


4 WEST ELEVATION
 SCALE: 1/4" = 1'-0"



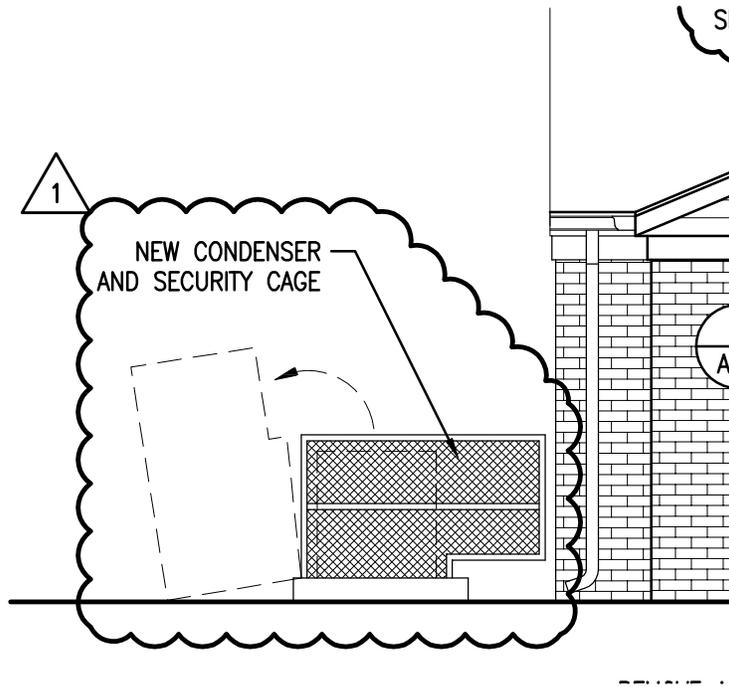

1 SOUTH ELEVATION
SCALE: 1/4" = 1'-0"

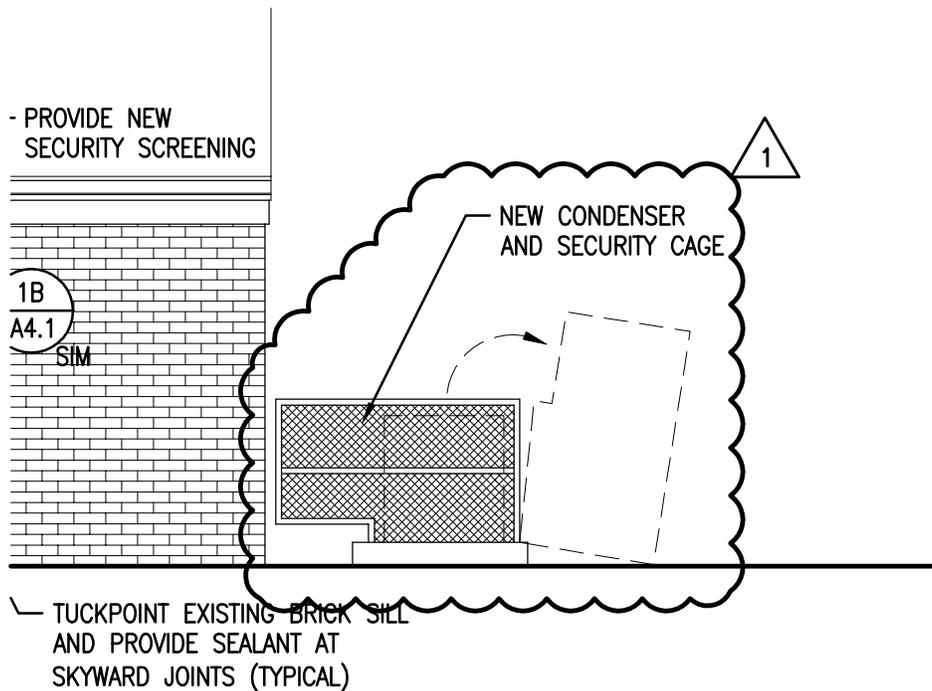


3 NORTH ELEVATION
SCALE: 1/4" = 1'-0"

REF. SHEET:
A3.1
DRAWING:
A3.1-5

DATE:
06/16/2014
PROJECT:
8528-1SHPK
QUORUM - 14001.01

ADDENDUM: 01




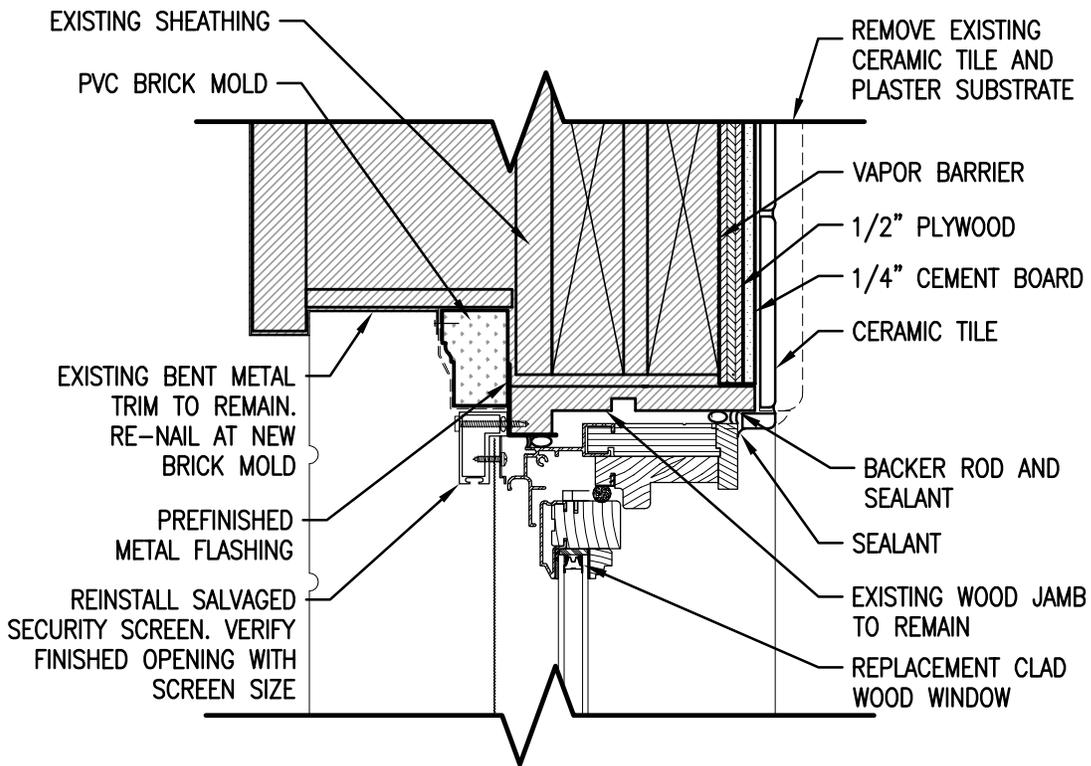

1A WINDOW HEAD DETAIL


SCALE: 3" = 1'-0"



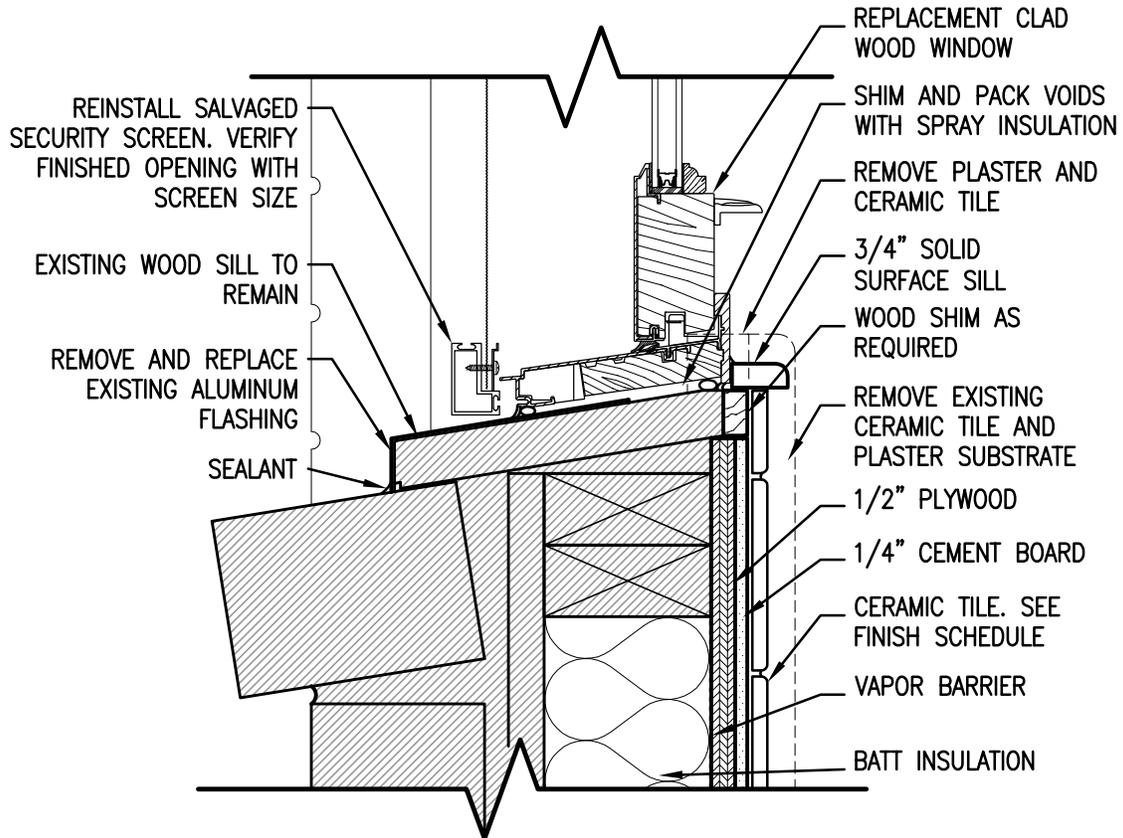


1B WINDOW SILL DETAIL
 SCALE: 3" = 1'-0"



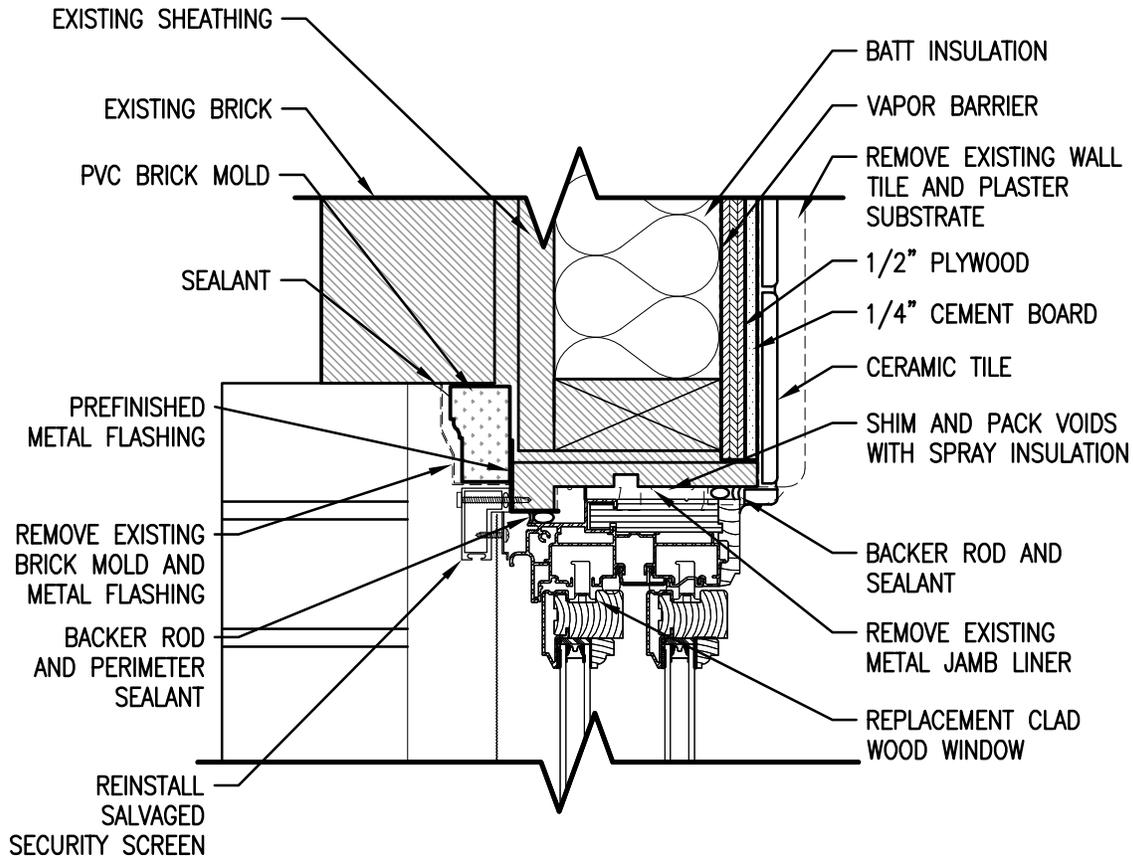


7 WINDOW JAMB DETAIL
 SCALE: 3" = 1'-0"



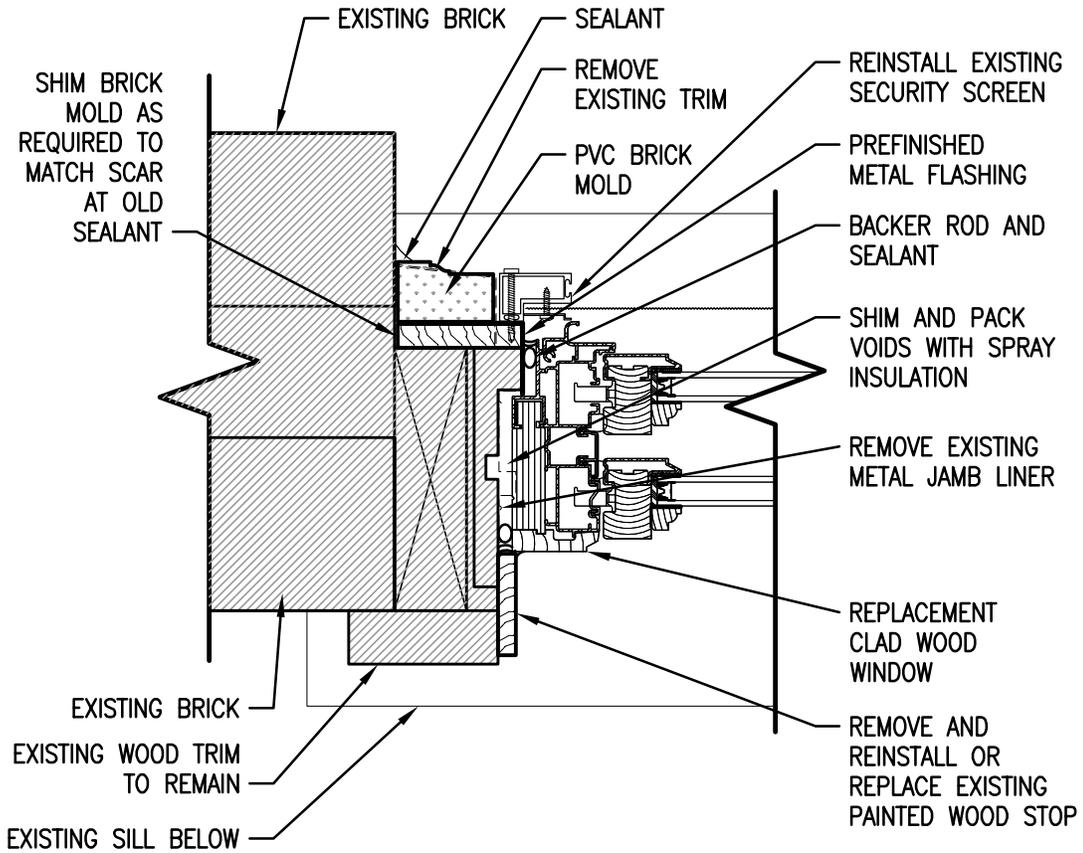


8 JAMB DETAIL @ NORTH GANGED WINDOWS
 SCALE: 3" = 1'-0"



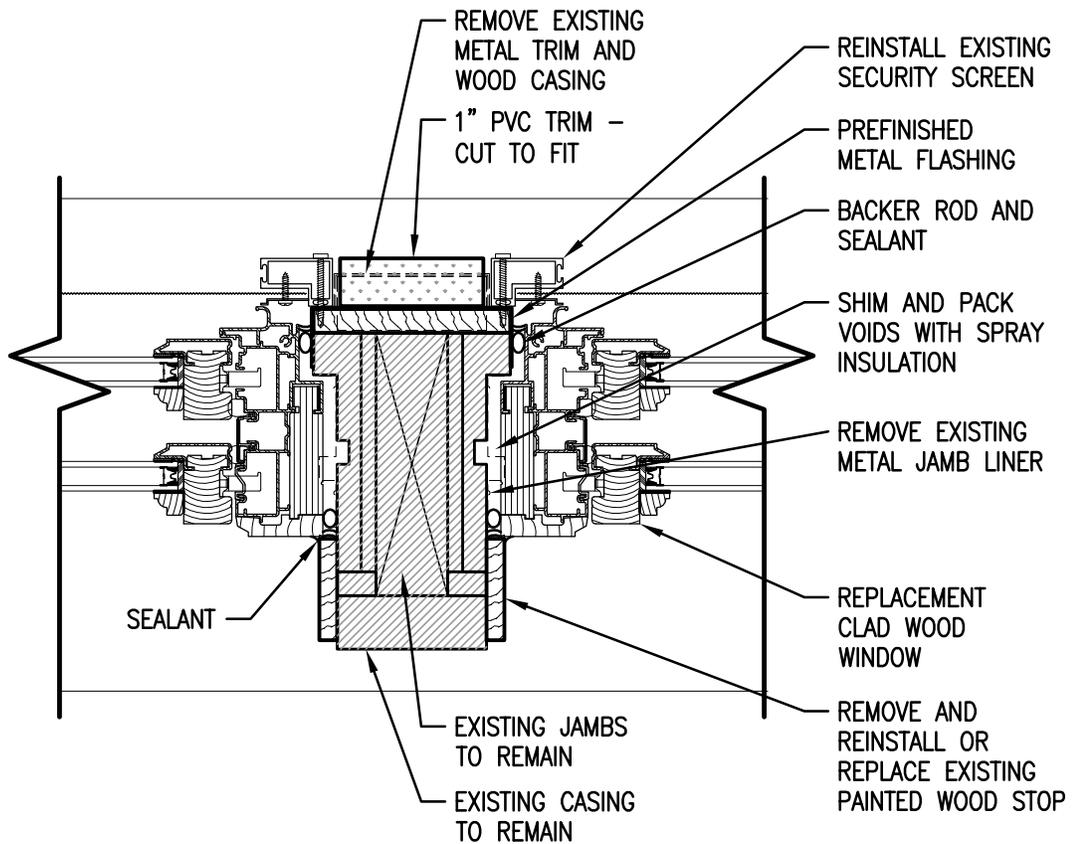


9 JAMB MULLION @ NORTH GANGED WINDOWS
 SCALE: 3" = 1'-0"



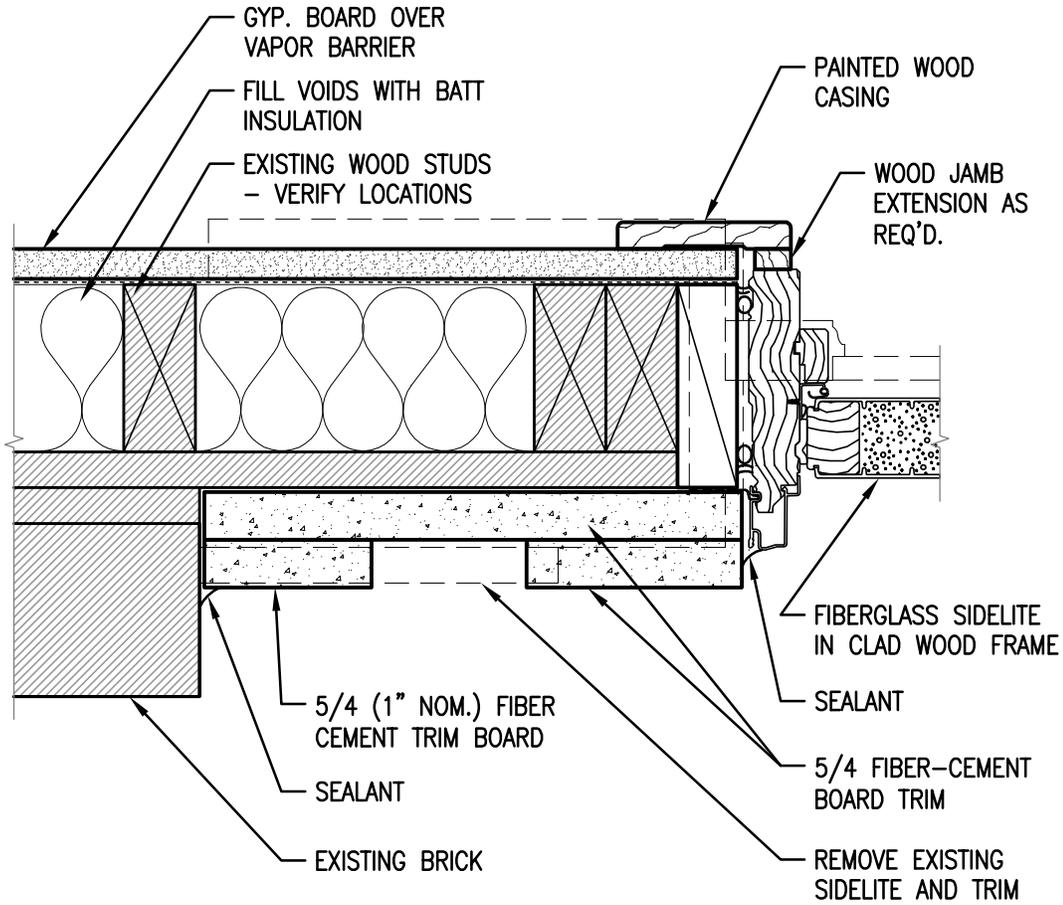


13 JAMB DETAIL AT NEW ENTRY SIDELITE
 SCALE: 3" = 1'-0"



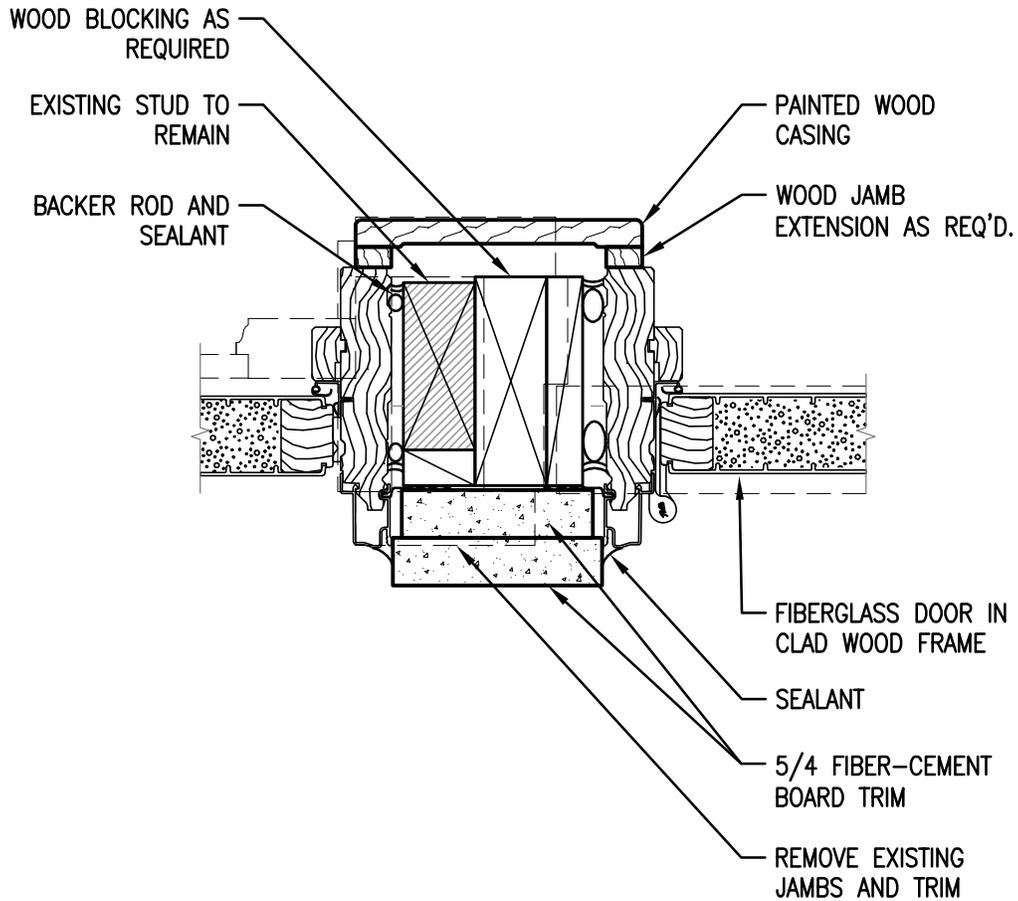


14 **JAMB DETAIL AT NEW ENTRY DOOR / SIDELITE**
 SCALE: 3" = 1'-0"



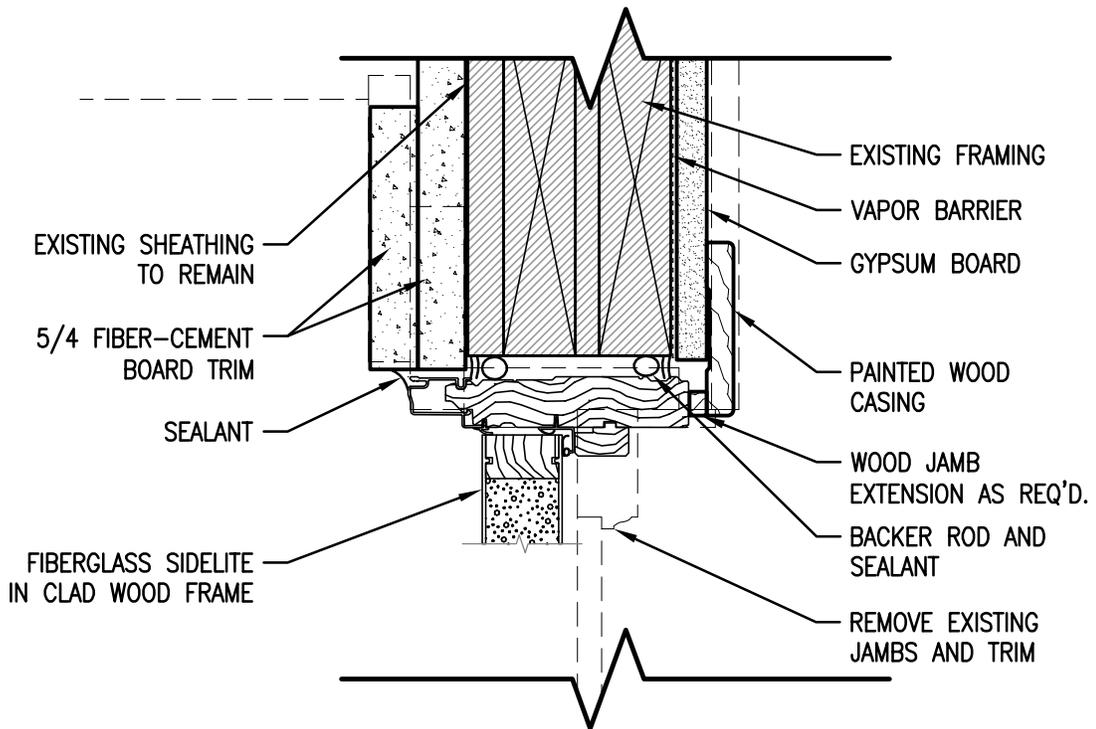


6 HEAD @ ENTRY SIDELITE (DOOR HEAD SIM.)
 SCALE: 3" = 1'-0"



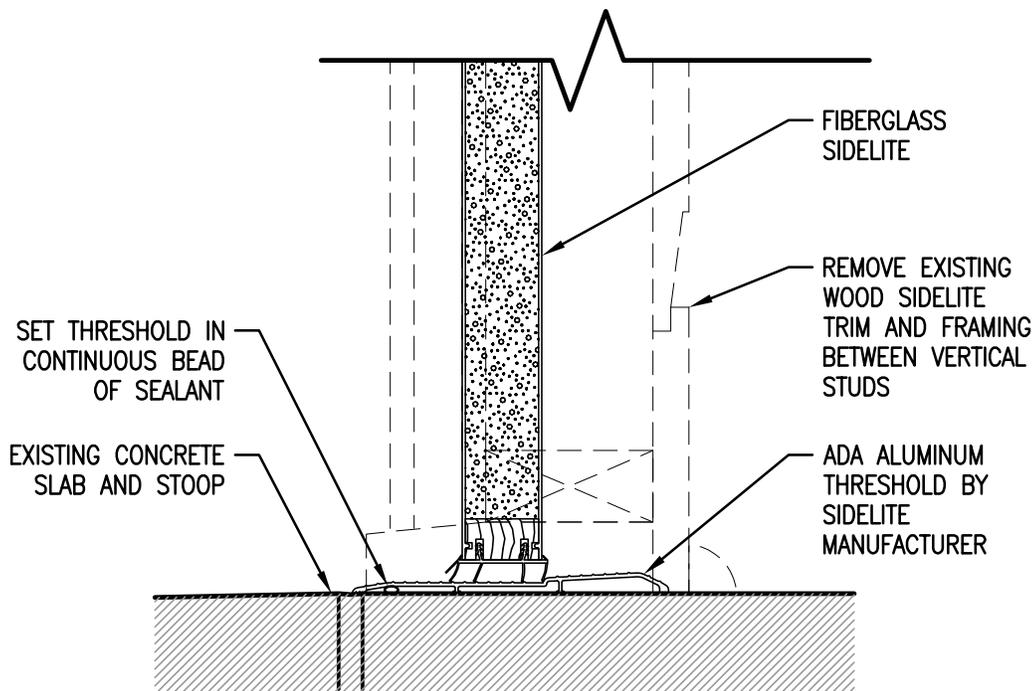

11 SILL @ ENTRY SIDELITE (DOOR SILL SIMILAR)
SCALE: 3" = 1'-0"




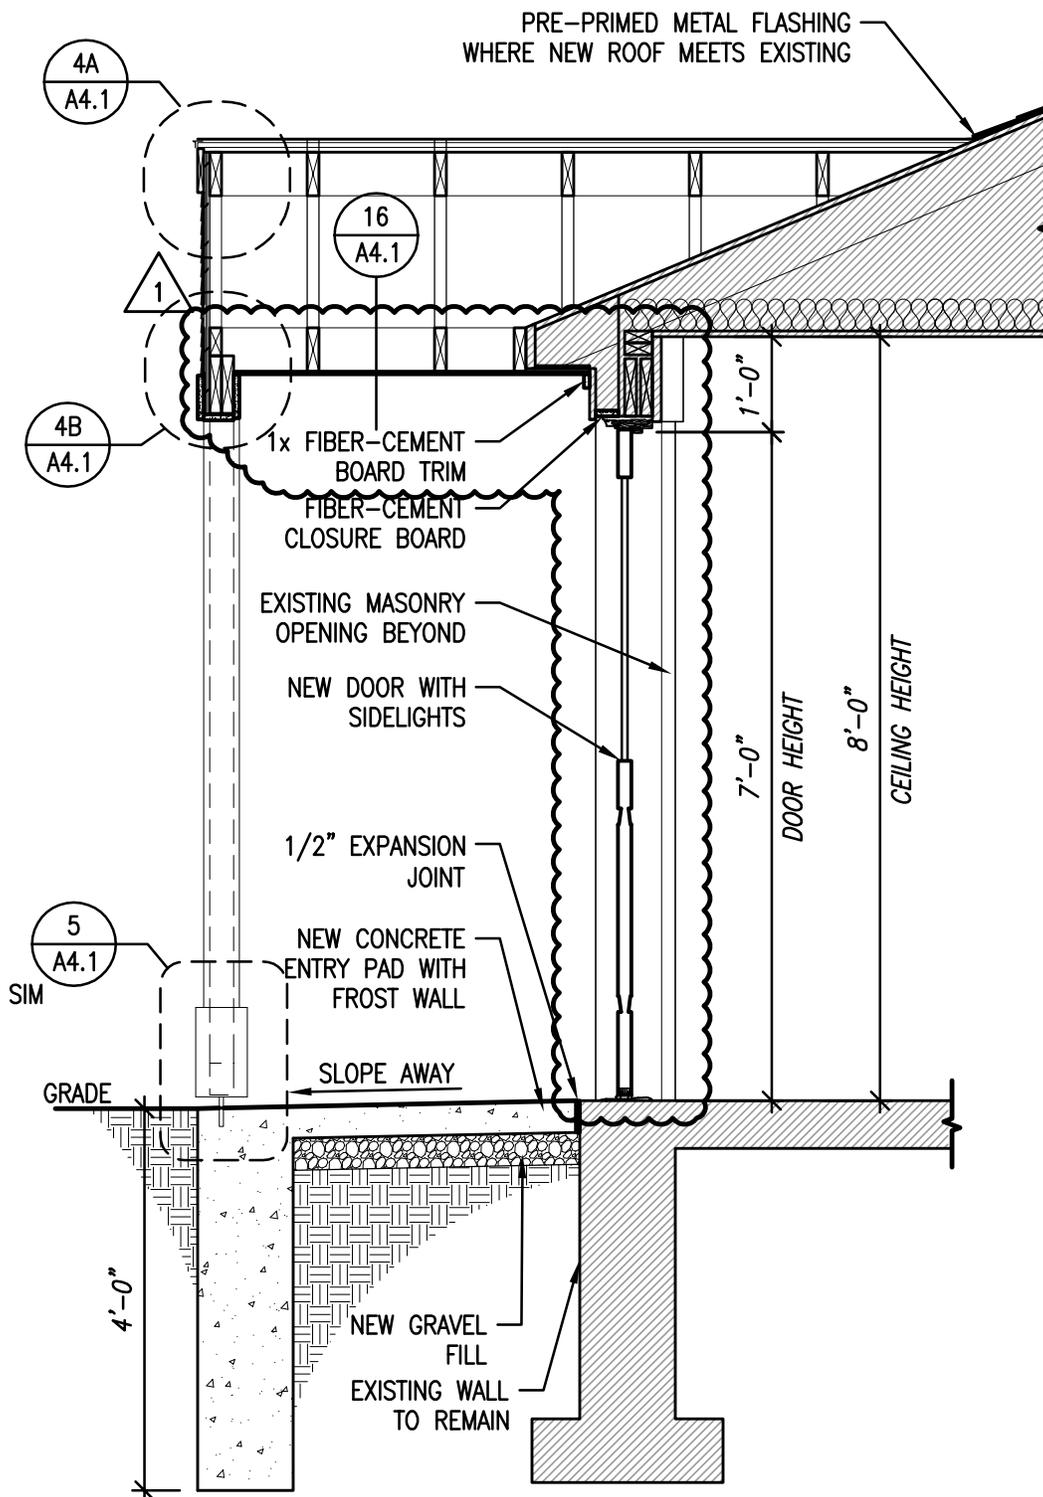

2 NORTH OVERHANG - ALTERNATE A
 SCALE: 1/2" = 1'-0"

REF. SHEET:
 A4.1
 DRAWING:
 A4.1-10




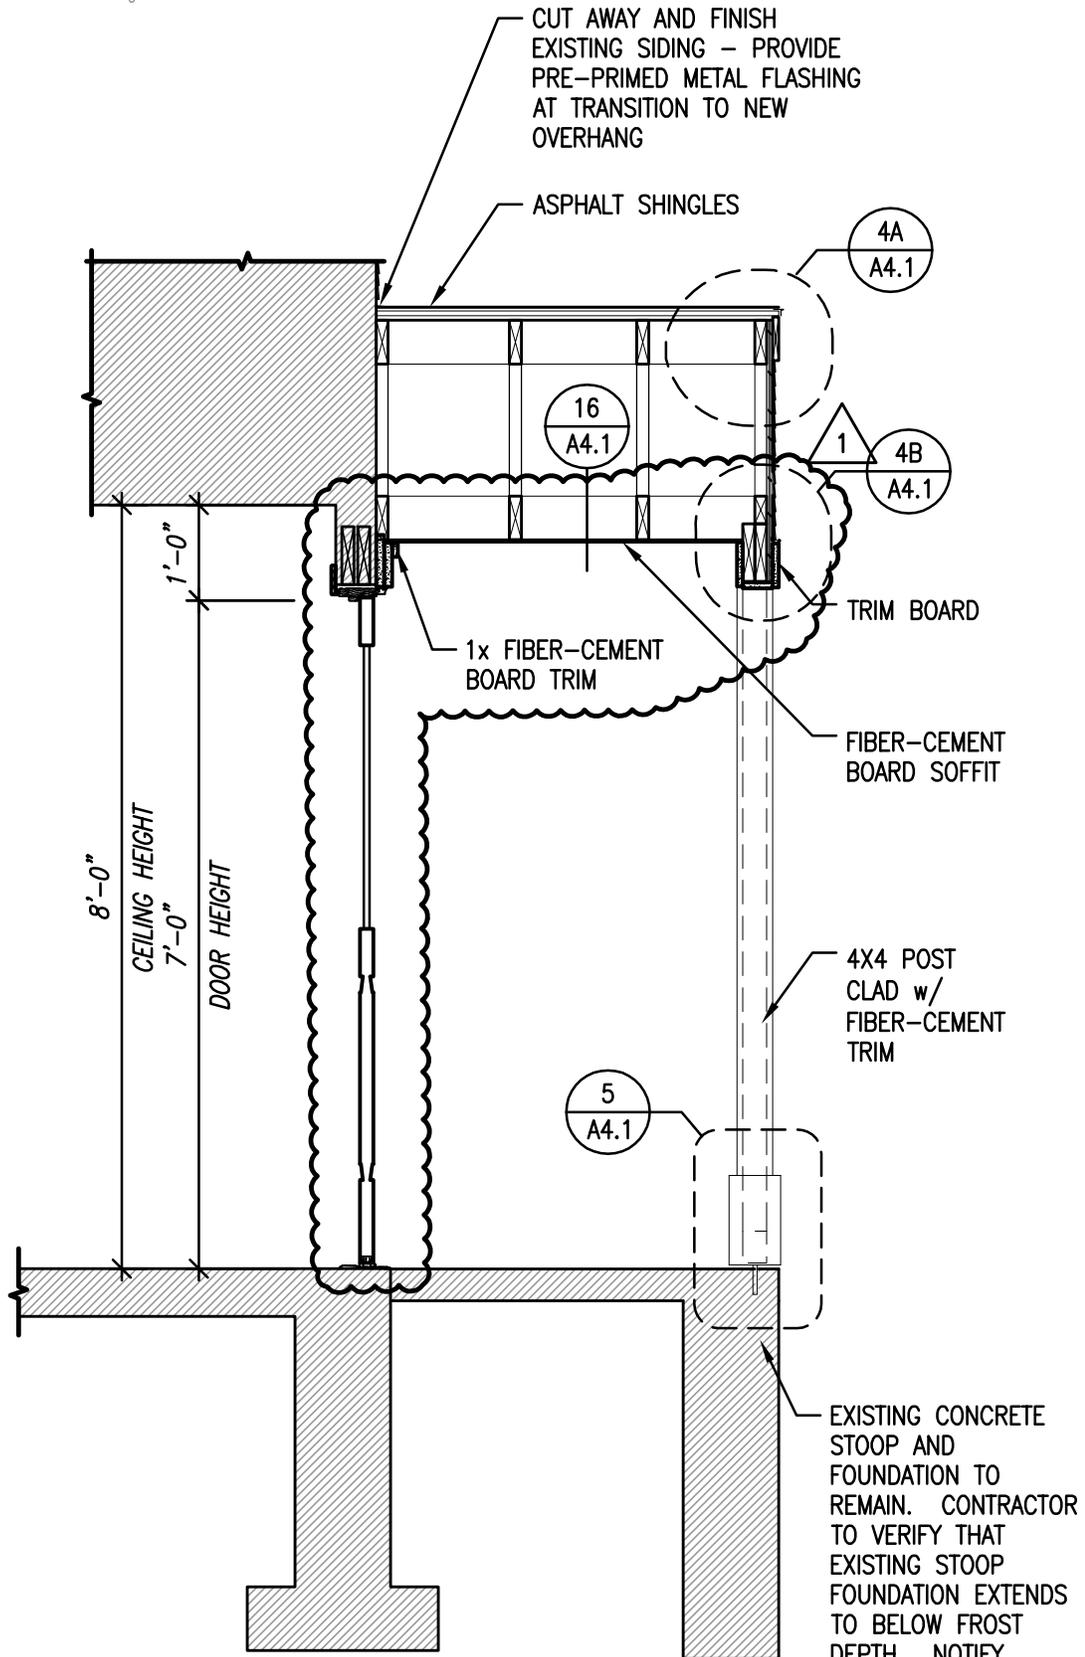

3 SOUTH OVERHANG SECTION
 SCALE: 1/2" = 1'-0"

REF. SHEET:
 A4.1
 DRAWING:
 A4.1-11




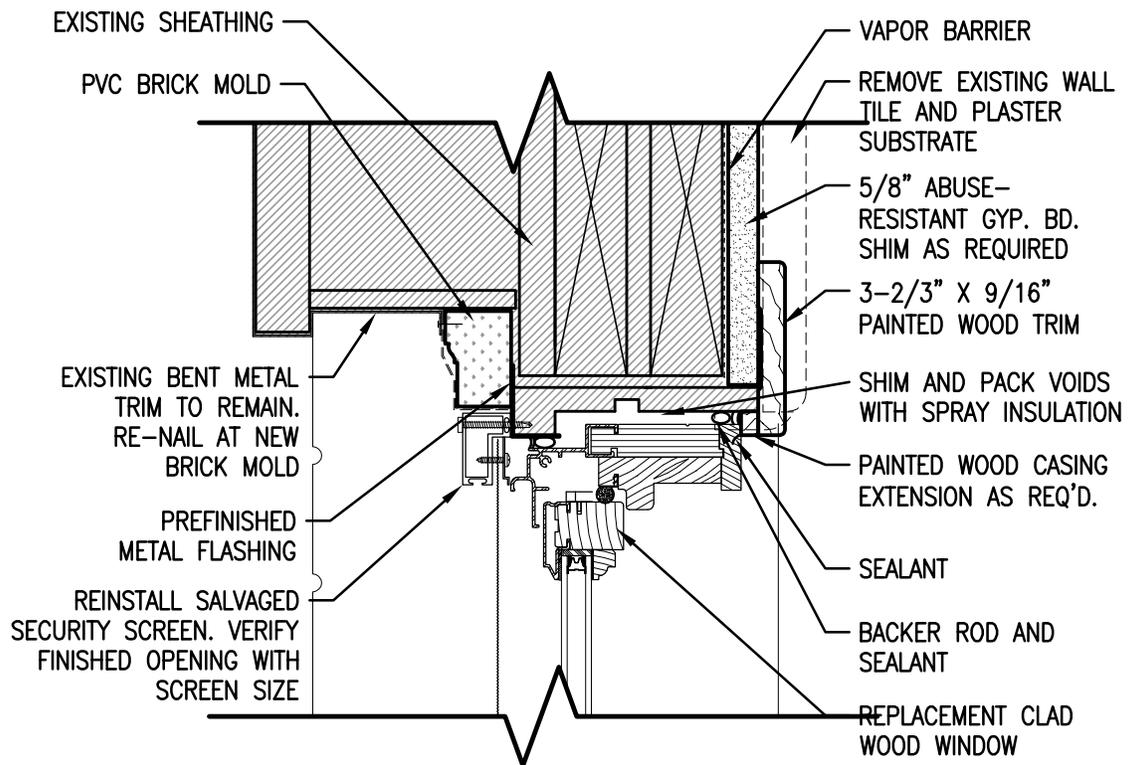

1 WINDOW HEAD DETAIL


SCALE: 3" = 1'-0"



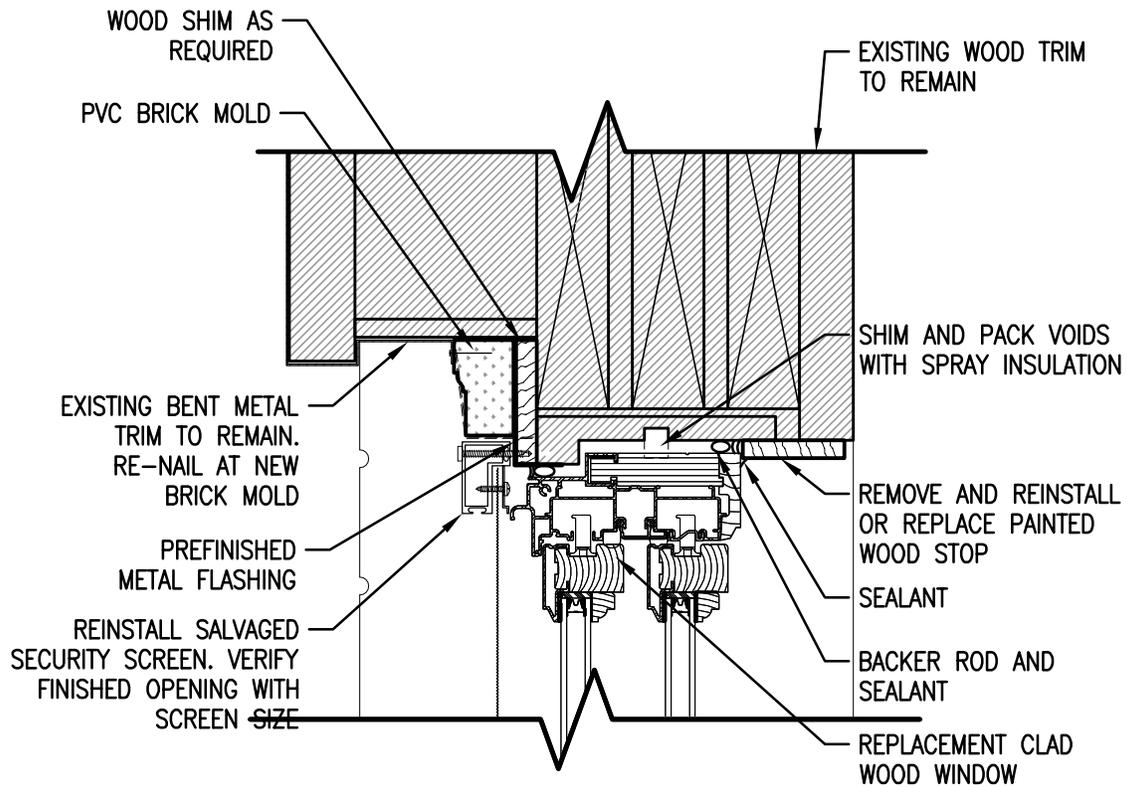


2 WINDOW HEAD DETAIL
SCALE: 3" = 1'-0"



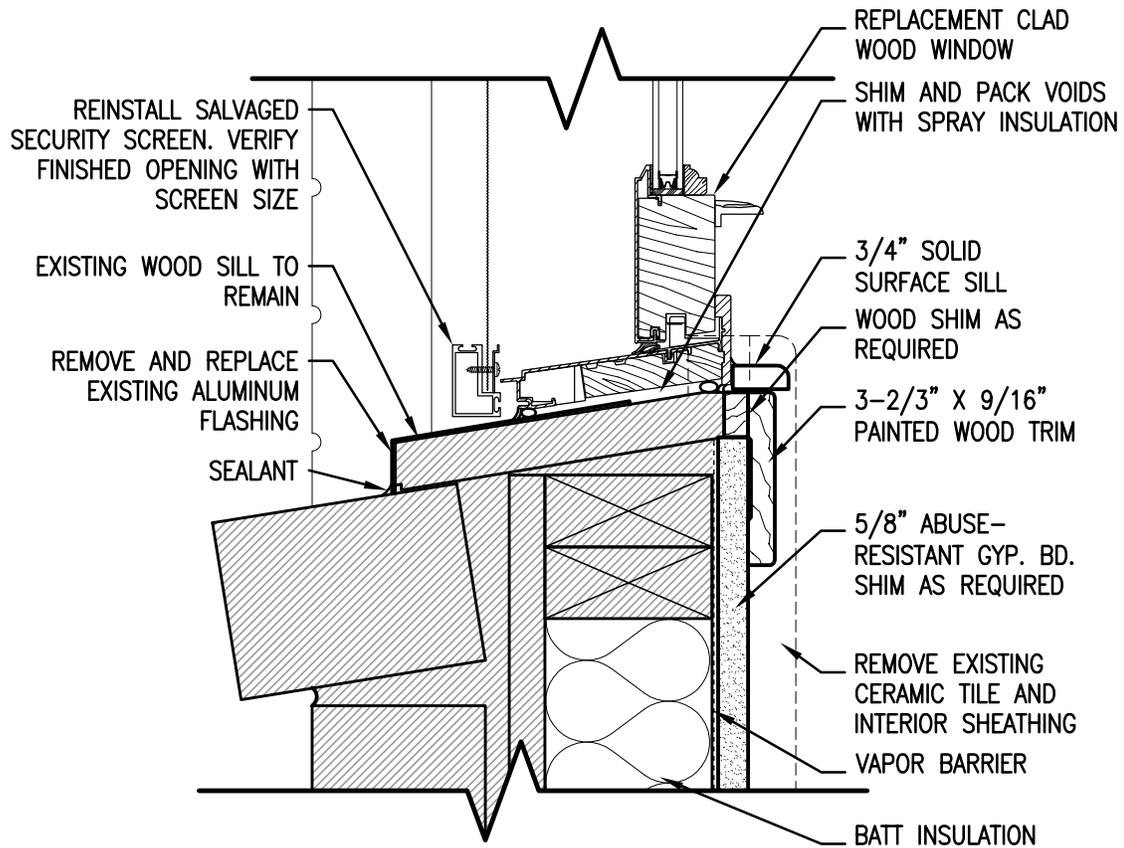


6 WINDOW SILL DETAIL
SCALE: 3" = 1'-0"



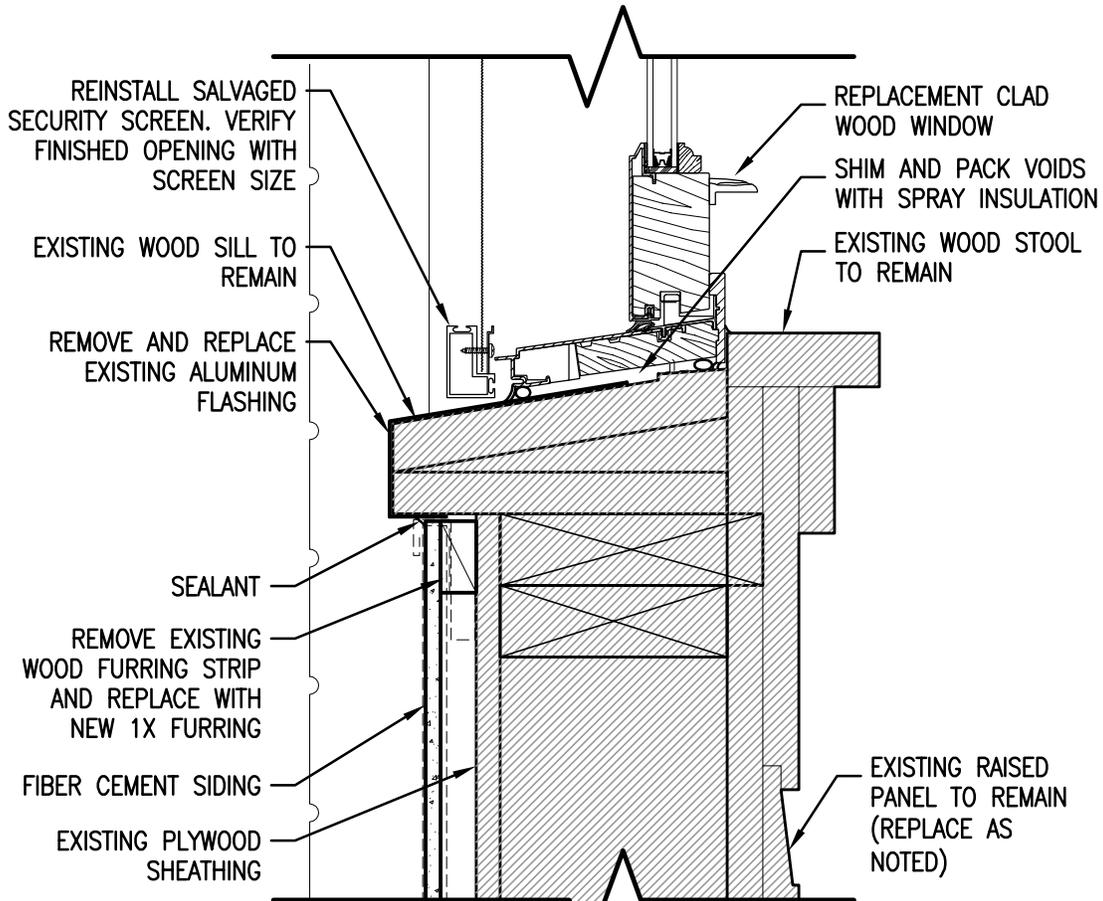


7 WINDOW SILL DETAIL AT NORTH WINDOWS
SCALE: 3" = 1'-0"



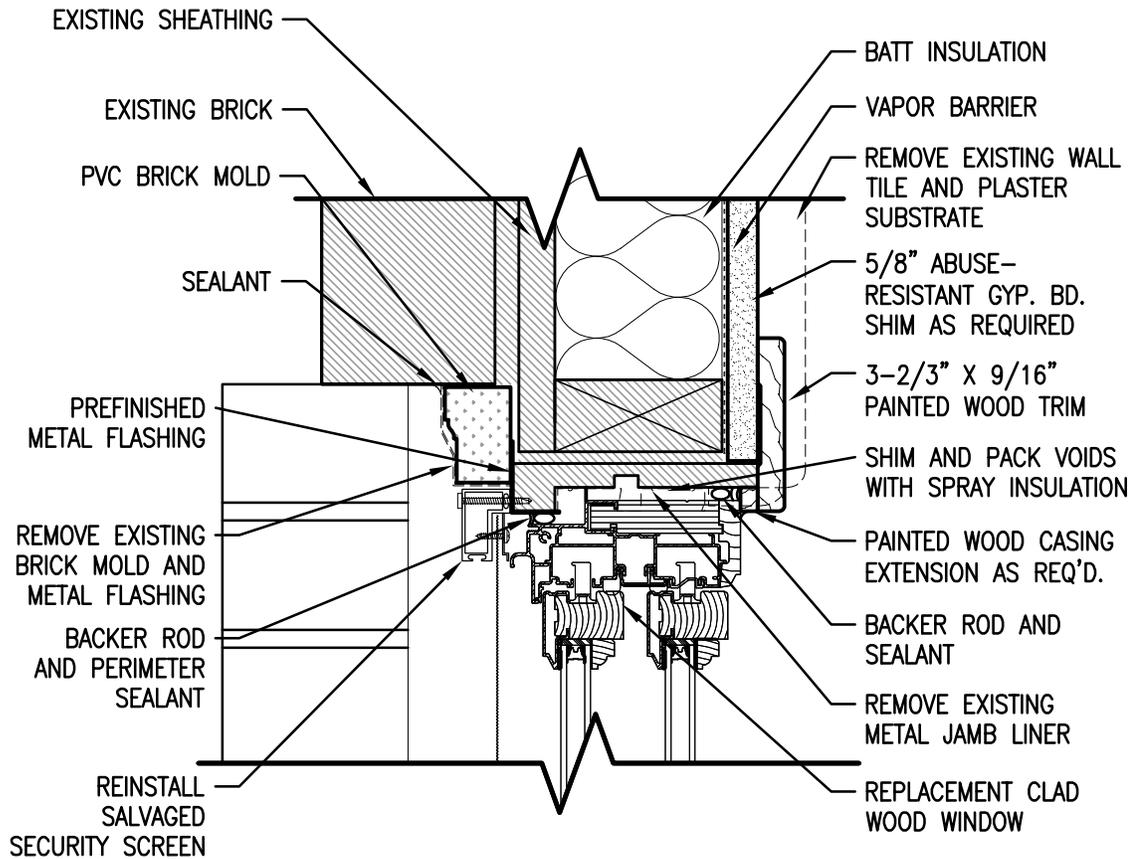


11 WINDOW JAMB DETAIL
 SCALE: 3" = 1'-0"



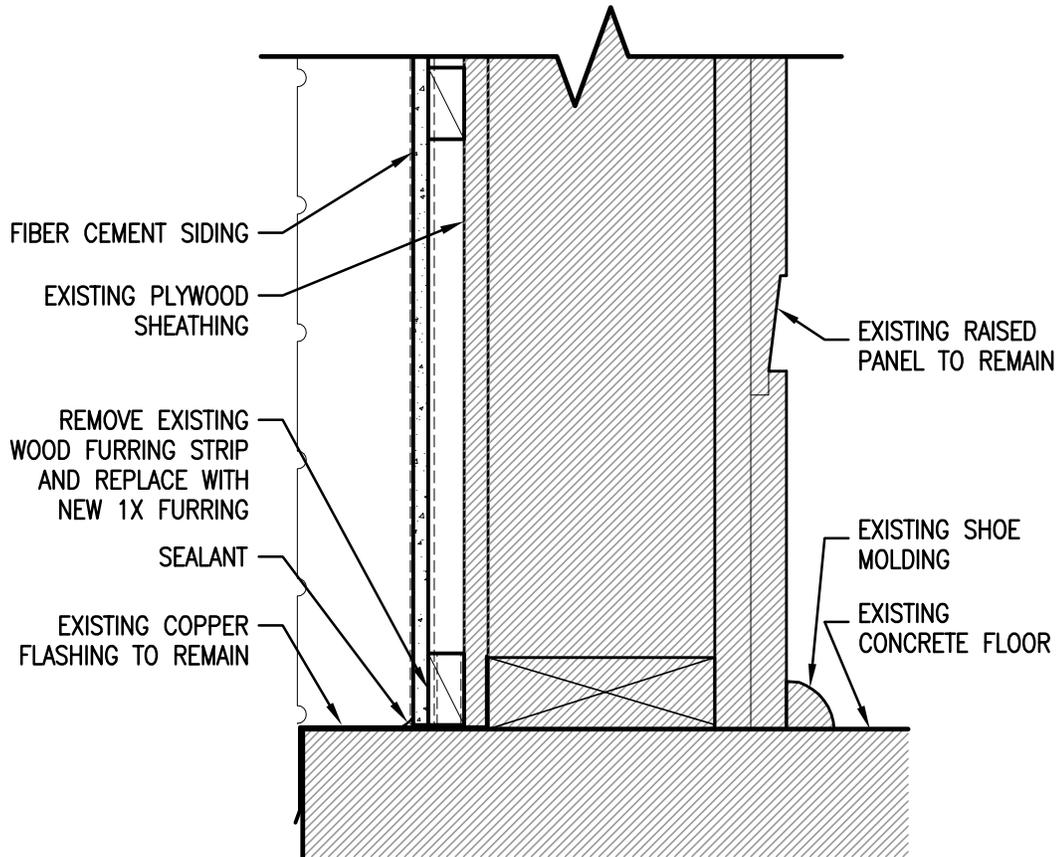


12 SILL DETAIL AT NORTH WINDOWS
 SCALE: 3" = 1'-0"



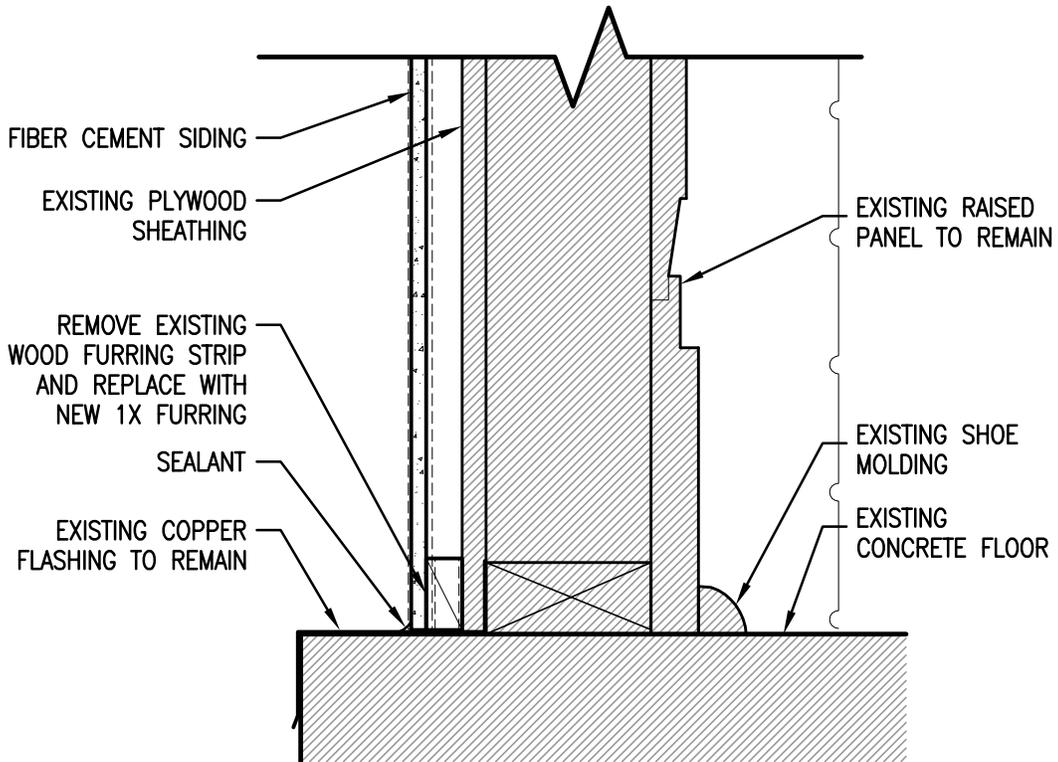


13 SILL DETAIL AT EAST WINDOWS
 SCALE: 3" = 1'-0"



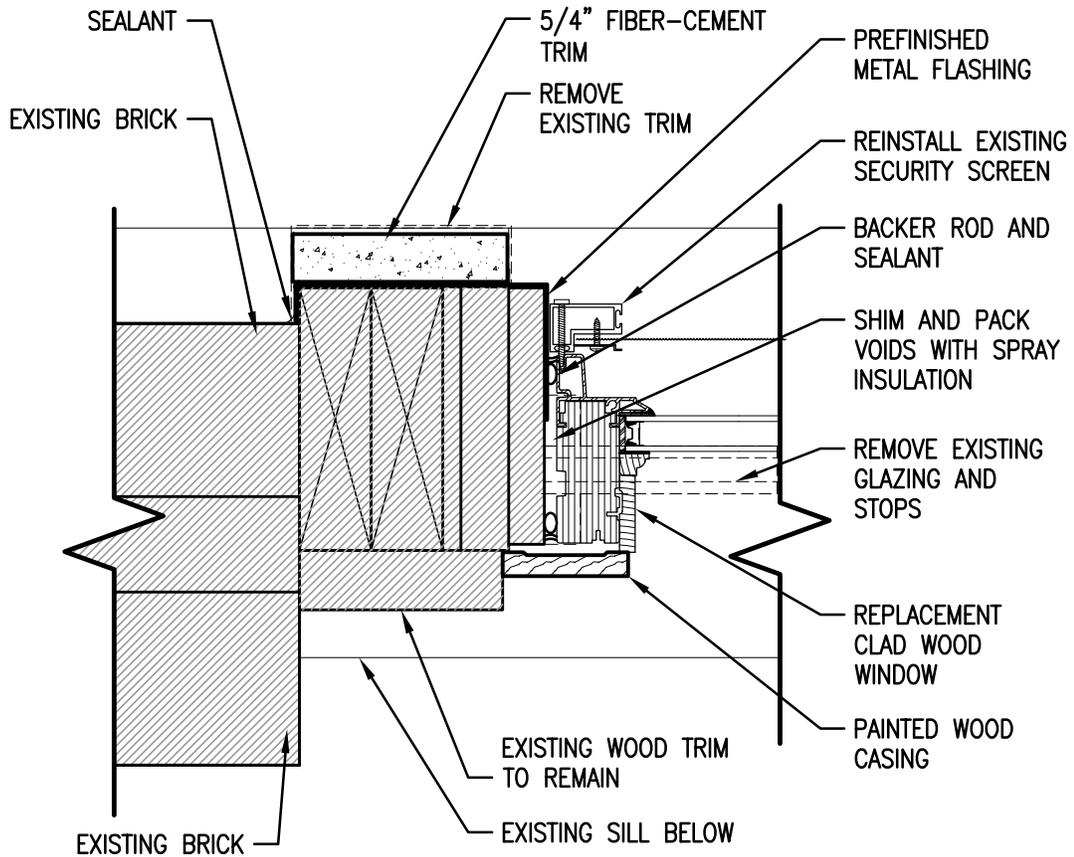


16 JAMB DETAIL @ EAST FIXED WINDOW (ALT.)
 SCALE: 3" = 1'-0"



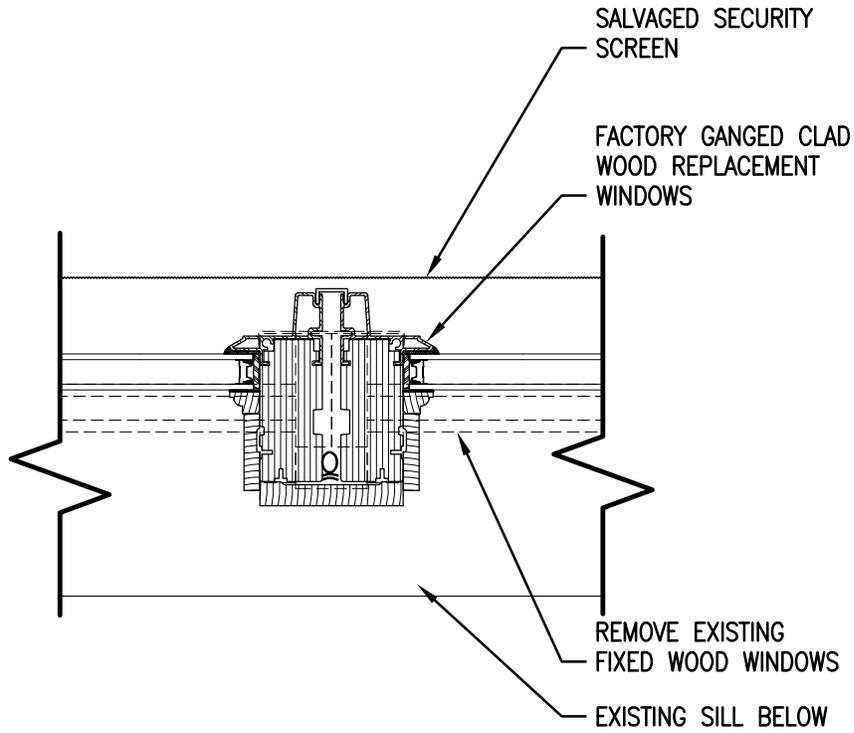

17 MULLION @ EAST FIXED WINDOW (ALT.)
 SCALE: 3" = 1'-0"



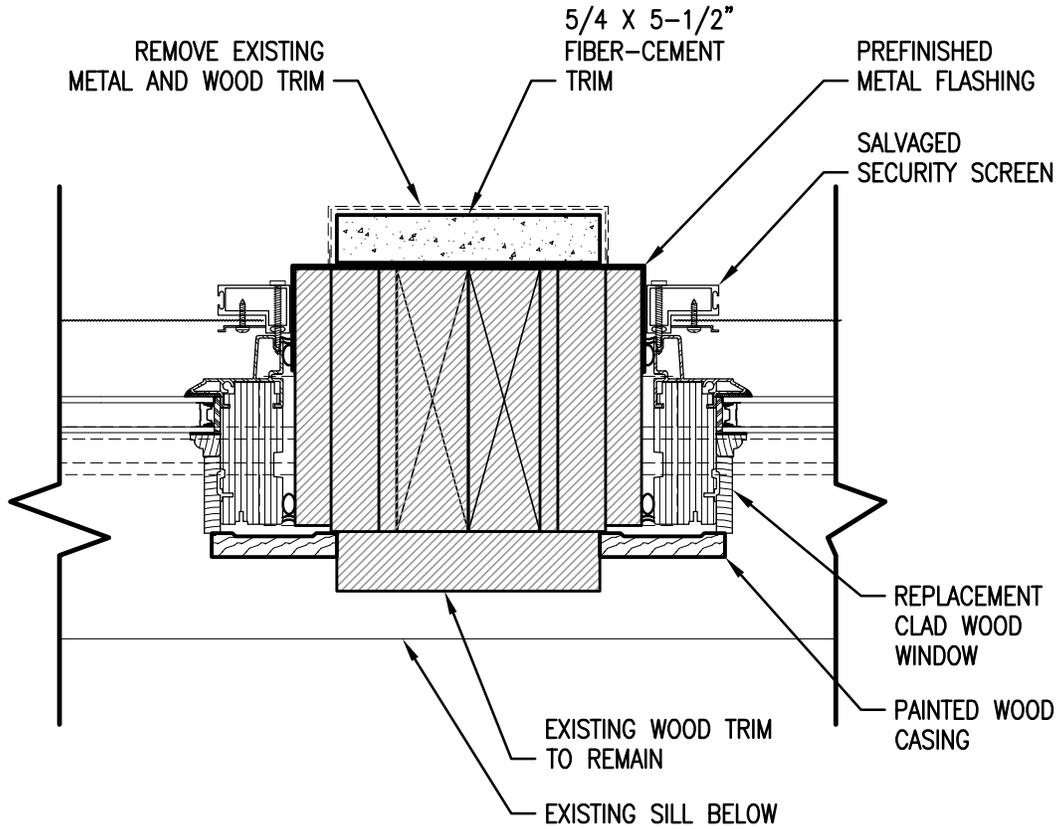

18 JAMB MULLION @ EAST FIXED WIND. (ALT.)
 SCALE: 3" = 1'-0"





DOOR HARDWARE

HARDWARE SET #1

BUTTS 1-1/2 PAIR BB: BY DOOR MANUFACTURER (NON REMOVABLE PIN)
 MORTISED ENTRY WITH KEYED DEADBOLT BOTH SIDES:
 LEVER AUTOMATICALLY RETRACTS DEAD BOLT - YALE 8817-2 X630
 CLOSER: LCN 4000 SERIES WITH OVERHEAD STOP (95') XSILVER
 KICKPLATE (PUSH SIDE): IVES 8400 10" X630
 THRESHOLD: BY DOOR MANUFACTURER - ADA HEIGHT
 WEATHER STRIPPING: BY DOOR MANUFACTURER

HARDWARE SET #2

BUTTS 1-1/2 PAIR: IVES 5BB1HW 4.5X4.5 XNRP
 MORTISED ENTRY WITH KEYED DEADBOLT BOTH SIDES:
 LEVER AUTOMATICALLY RETRACTS DEAD BOLT - YALE 8817-2 X630
 KICKPLATE (PUSH SIDE): IVES 8400 10" X630
 CLOSER WITH HOLD OPEN: LCN 4000 SERIES WITH OVERHEAD STOP (95') XSILVER
 WALL STOP: IVES WS407 CCV X630
 THRESHOLD: REESE S225A (1/4" HEIGHT)

HARDWARE SET #3

BUTTS 1-1/2 PAIR: IVES 4.5X4.5 X NRP
 LOCK SET - CLASSROOM FUNCTION:
 YALE 4708 LN X 630
 WALL STOP: IVES WS407 CCV X630

HARDWARE SET #4

LOCK SET - CLASSROOM FUNCTION:
 YALE 4708 LN X 630
 WALL STOP: IVES WS407 CCV X630

SPECIALTIES


- SS-1 SOLID SURFACE
 MANUFACTURER: CORIAN OR EQUAL
 COLOR: DOVE
 FINISH: MATTE
 CONTACT:
- CM-1 CROWN MOLDING
 MANUFACTURER: BLIFFERT OR EQUAL
 COLOR: SW 7555 PATIENCE
 PROFILE: BLF-227
 MOLDING SIZE: 5/8" X 1-5/8"
- ST-1 WOOD STAIN
 COLOR: MATCH WILSONART
 HARVEST MAPLE 7953-38
 SHEEN: SATIN
- CB-1 CEMENT BOARD SIDING
 MANUFACTURER: JAMES HARDIE OR EQUAL
 COLOR: PRIMED FOR PAINTING
 STYLE: SIERRA 8



CB-2 CEMENT BOARD LAP SIDING
 MANUFACTURER: JAMES HARDIE OR EQUAL
 EXPOSURE: 4"
 COLOR: PRIMED FOR PAINTING
 STYLE: SELECT CEDARMILL COLOR PLUS



FRAME TYPES

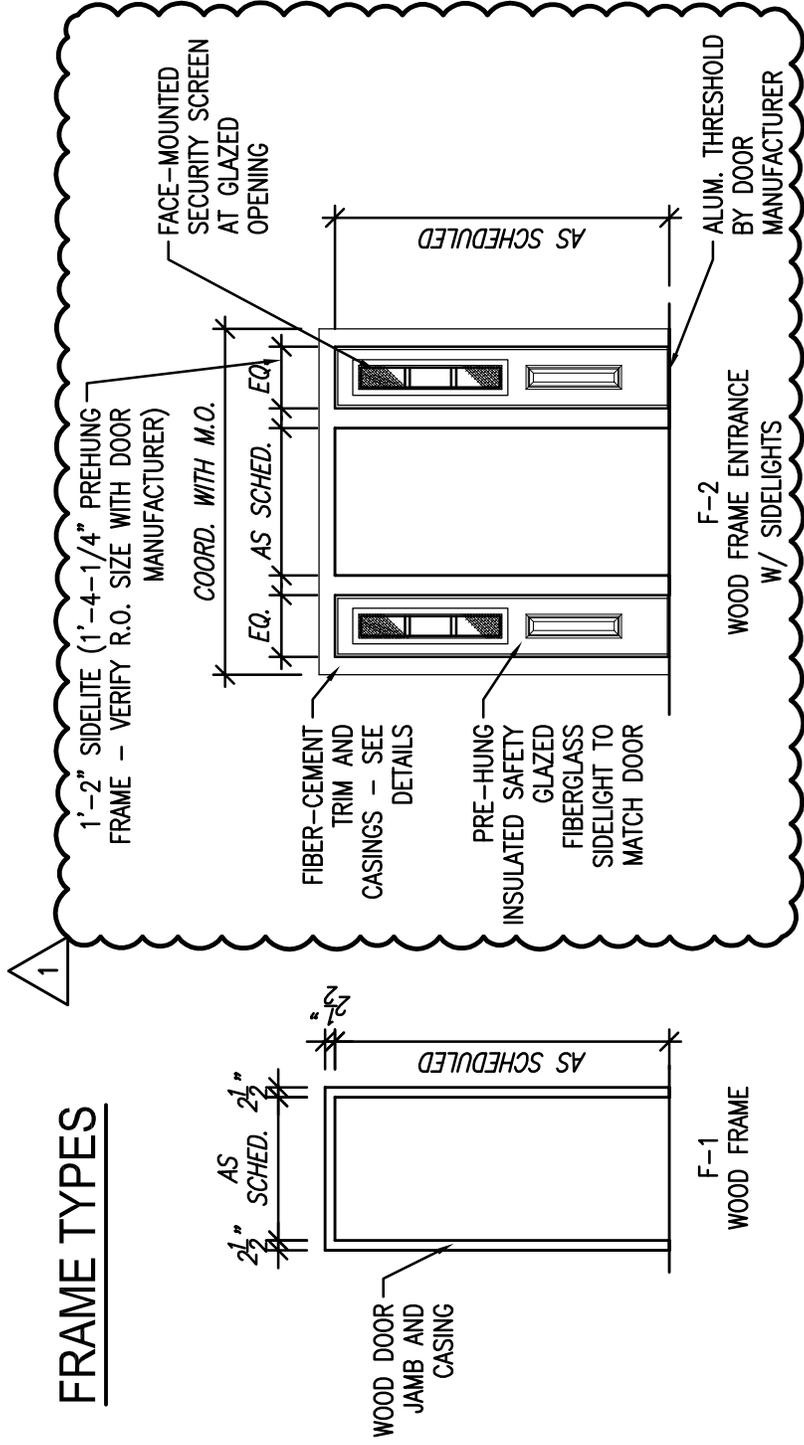

Milwaukee County Dept. of Administrative Services
 FACILITIES MANAGEMENT DIVISION
 Architectural, Engineering & Environmental Services
 CITY CAMPUS 2711 W. WELLS ST., 2ND FLOOR MILWAUKEE, WI 53208




Renovation of
SHERIDAN PARK PAVILION
 4800 South Lake Drive, Cudahy, Wisconsin 53110

REF. SHEET:
 A5.1
 DRAWING:
 A5.1-2

DATE:
 06/16/2014
 PROJECT:
 8528-1SHPK
 QUORUM - 14001.01

ADDENDUM: 01

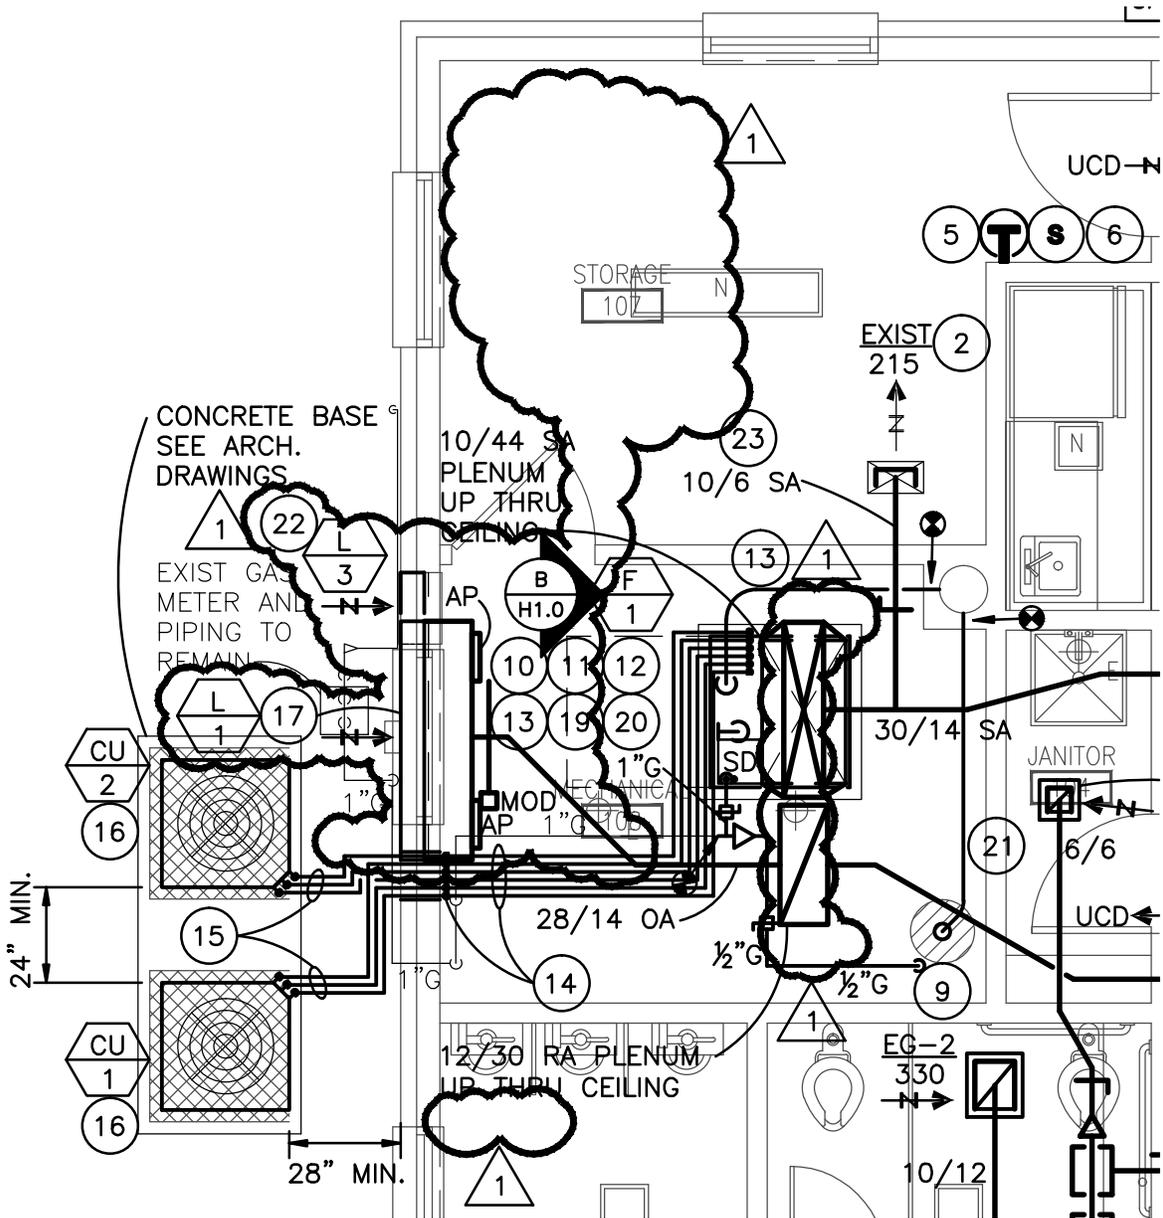


- 17. LOUVER L-1 FOR OUTSIDE AIR INTAKE, WITH BIRDSCREEN. PROVIDE 60"x24"x18" INSULATED PLENUM WITH (2) 12"x12" ACCESS PANELS. INSTALL LOUVER L-1 PER MANUFACTURERS RECOMMENDATIONS.
- 18. NEW EXHAUST FAN IN ATTIC, SUPPORT FROM STRUCTURE PER SPECIFICATIONS AND MANUFACTURER'S RECOMMENDATIONS.
- 19. EXTEND 5" DIA. COMBUSTION AIR INTAKE INTO ROOM.
- 22. 16"x16" HEAVY-DUTY WALL LOUVER FOR COMBUSTION AIR INTAKE. PROVIDE SCREEN IN REMOVABLE FRAME.

PARTIAL FIRST FLOOR PLAN - HVAC



H1



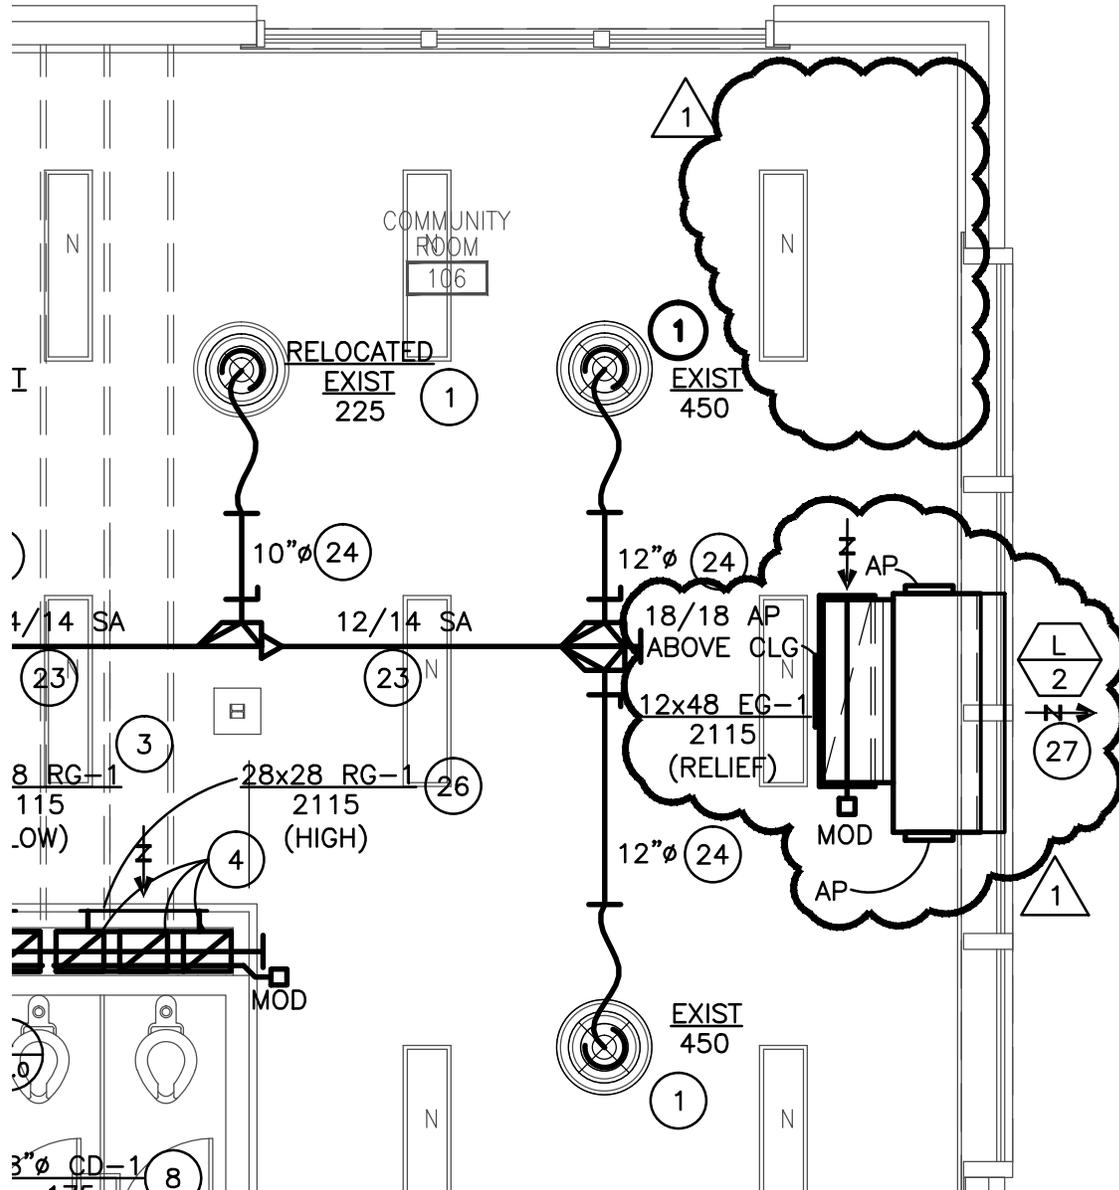


27. 48"x12" RELIEF AIR DUCT UP W/ MOTOR OPERATED DAMPER AND 18"x18" AP, TO 60"x24"x24" INSULATED PLENUM W/(2)12"x12" AP. CONNECT PLENUM TO LOUVER L-2. INSTALL LOUVER L-2 PER MANUFACTURERS RECOMMENDATION.

PARTIAL FIRST FLOOR PLAN - HVAC



H2



REFERENCE H1.0


Milwaukee County Dept. of Administrative Services
 FACILITIES MANAGEMENT DIVISION
 Architectural, Engineering & Environmental Services
 CITY CAMPUS 2711 W. WELLS ST, 2ND FLOOR MILWAUKEE, WI 53208




Renovation of
SHERIDAN PARK PAVILION
 4800 South Lake Drive, Cudahy, Wisconsin 53110

REF. SHEET: H1.0
 DATE: 06/16/2014
 PROJECT: 8528-1SHPK
 QUORUM - 14001.01

ADDENDUM: 01

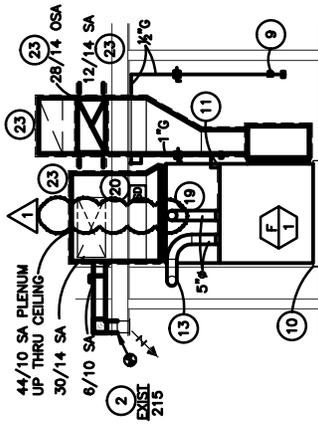

B ELEVATION
SCALE: 3/8"=1'-0"



A SECTION
SCALE: 3/8"=1'-0"

LOUVER SCHEDULE

MARK	SERVICE	STYLE	SIZE (INCHES)		CFM	FREE AREA VEL. F.P.M.	GROSS AREA VEL. F.P.M.	MAX. A.P.D. IN. W.C.	MATERIAL	FINISH	BIRD SCREEN	MANUFACTURER		REMARKS
			LENGTH	HEIGHT								DEPTH	MAKE	
L-1	OUTSIDE AIR	DRAINABLE	60	24	6	570	285	1.0	ALUM.	PAINTED	YES	AEROLITE	K6776	ARCHITECT TO SELECT COLOR ①
L-2	RELIEF AIR	DRAINABLE	60	24	6	425	212	1.0	ALUM.	PAINTED	YES	AEROLITE	K6776	ARCHITECT TO SELECT COLOR ①
L-3	COMB. AIR	DRAINABLE	16	16	6	325	156	1.0	ALUM.	PAINTED	YES	AEROLITE	K6776	ARCHITECT TO SELECT COLOR ①
NOTE: ① CUSTOM LOUVER SHAPE, REFER TO ARCHITECTURAL DRAWING A3.1.														

①

REFERENCE H1.0

Milwaukee County Dept. of Administrative Services
FACILITIES MANAGEMENT DIVISION
Architectural, Engineering & Environmental Services
CITY CAMPUS 2711 W. WELLS ST. 2ND FLOOR MILWAUKEE, WI 53208



Renovation of
SHERIDAN PARK PAVILION
4800 South Lake Drive, Cudahy, Wisconsin 53110

H3

REF. SHEET: H1.0
DATE: 06/16/2014
PROJECT: 8528-1SHPK
QUORUM - 14001.01

ADDENDUM: 01

PLAN NOTES:
E2.2

1

1. TYPE "WA" MOUNTING HEIGHT SHALL BE 8'-0" AFG.
2. RELOCATE LIGHTING FIXTURE TO BELOW HVAC LOUVER. REFER TO ARCHITECTURAL DRAWING A3.1-1.
3. LOCATE TYPE "EW" ABOVE TYPE "WA". AIM TO ILLUMINATE PATH OF EGRESS.
4. PROVIDE KEY OPERATE TYPE TOGGLE SWITCH. INCLUDE (12) TWELVE KEYS AND TURN OVER TO OWNER.





PLAN NOTES:

1. PROPERLY DISCONNECT INCOMING ELECTRIC SERVICE AND THEN REMOVE AND REPLACE EXISTING PANEL "EP" WITH A NEW PANEL "EP"
2. PROPERLY DISCONNECT POWER TO THIS EXISTING 50A RECEPTACLE, REMOVE AND RELOCATE INTO A NEW SURFACE MOUNTED FS TYPE DIE-CAST DEVICE BOX WITH DIE-CAST, LOCKABLE "WHILE-IN-USE" COVERPLATE.



3. RELOCATE EXISTING CONDUIT AND JUNCTION BOX TO BELOW HVAC LOUVER. REFER TO ARCHITECTURAL DRAWING A3.1-1.

