IMPORTANT

Patch-in waterproofing of entry section into plunge area shall be done per specifications after installation of slide(s).

Verify cut-out and dimensions with Slide manufacturer.

Slide shall be installed per manufacturer's specifications.

NOTE:
Section 13150 Contractor shall verify actual dimensions with Slide manufacturer.

WATER FLUME CUT-OUT NOTE — PL220-3

SCALE: NONE

ARROWS DENOTE DIRECTION OF FLOW

INLET SUPPLY
ACTIVITY SUPPLY
ACTIVITY SUPPLY 2
GEYSER SUPPLY

SLIDE SUPPLY
FLUME SUPPLY

GUTTER DRAIN LINE
MAIN DRAIN LINE

POOL UNDERDRAIN
POOL DRAIN
SURGE TANK DRAIN

PIPING SCHEMATIC LINETYPE KEY — PL220-4

SCALE: NONE

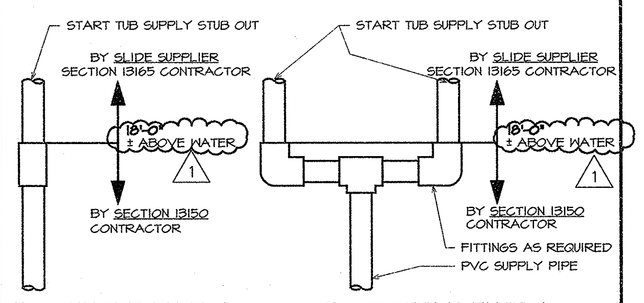

A: SINGLE ENTRY B: DOUBLE ENTRY

NOTES:
VERIFY PLATFORM HEIGHT 1
SECTION 13150 SHALL COORDINATE EXACT ELEVATION OF PIPE TERMINATIONS ON STARTING TUB STUB OUTS.

START TUB PLUMBING SCHEMATIC — PL220-6

SCALE: NONE

IMPORTANT

NOTES: VERIFY SLIDE PIPING RISER LOCATIONS, QUANTITY OF CONNECTION POINTS, & CONNECTION SIZE WITH SLIDE MANUFACTURER.

-COORDINATE THE LOCATION OF UNDERGROUND PIPING WITH THE SLIDE FOUNDATIONS AS WELL AS EXISTING POOL PIPING & EXISTING STRUCTURES.

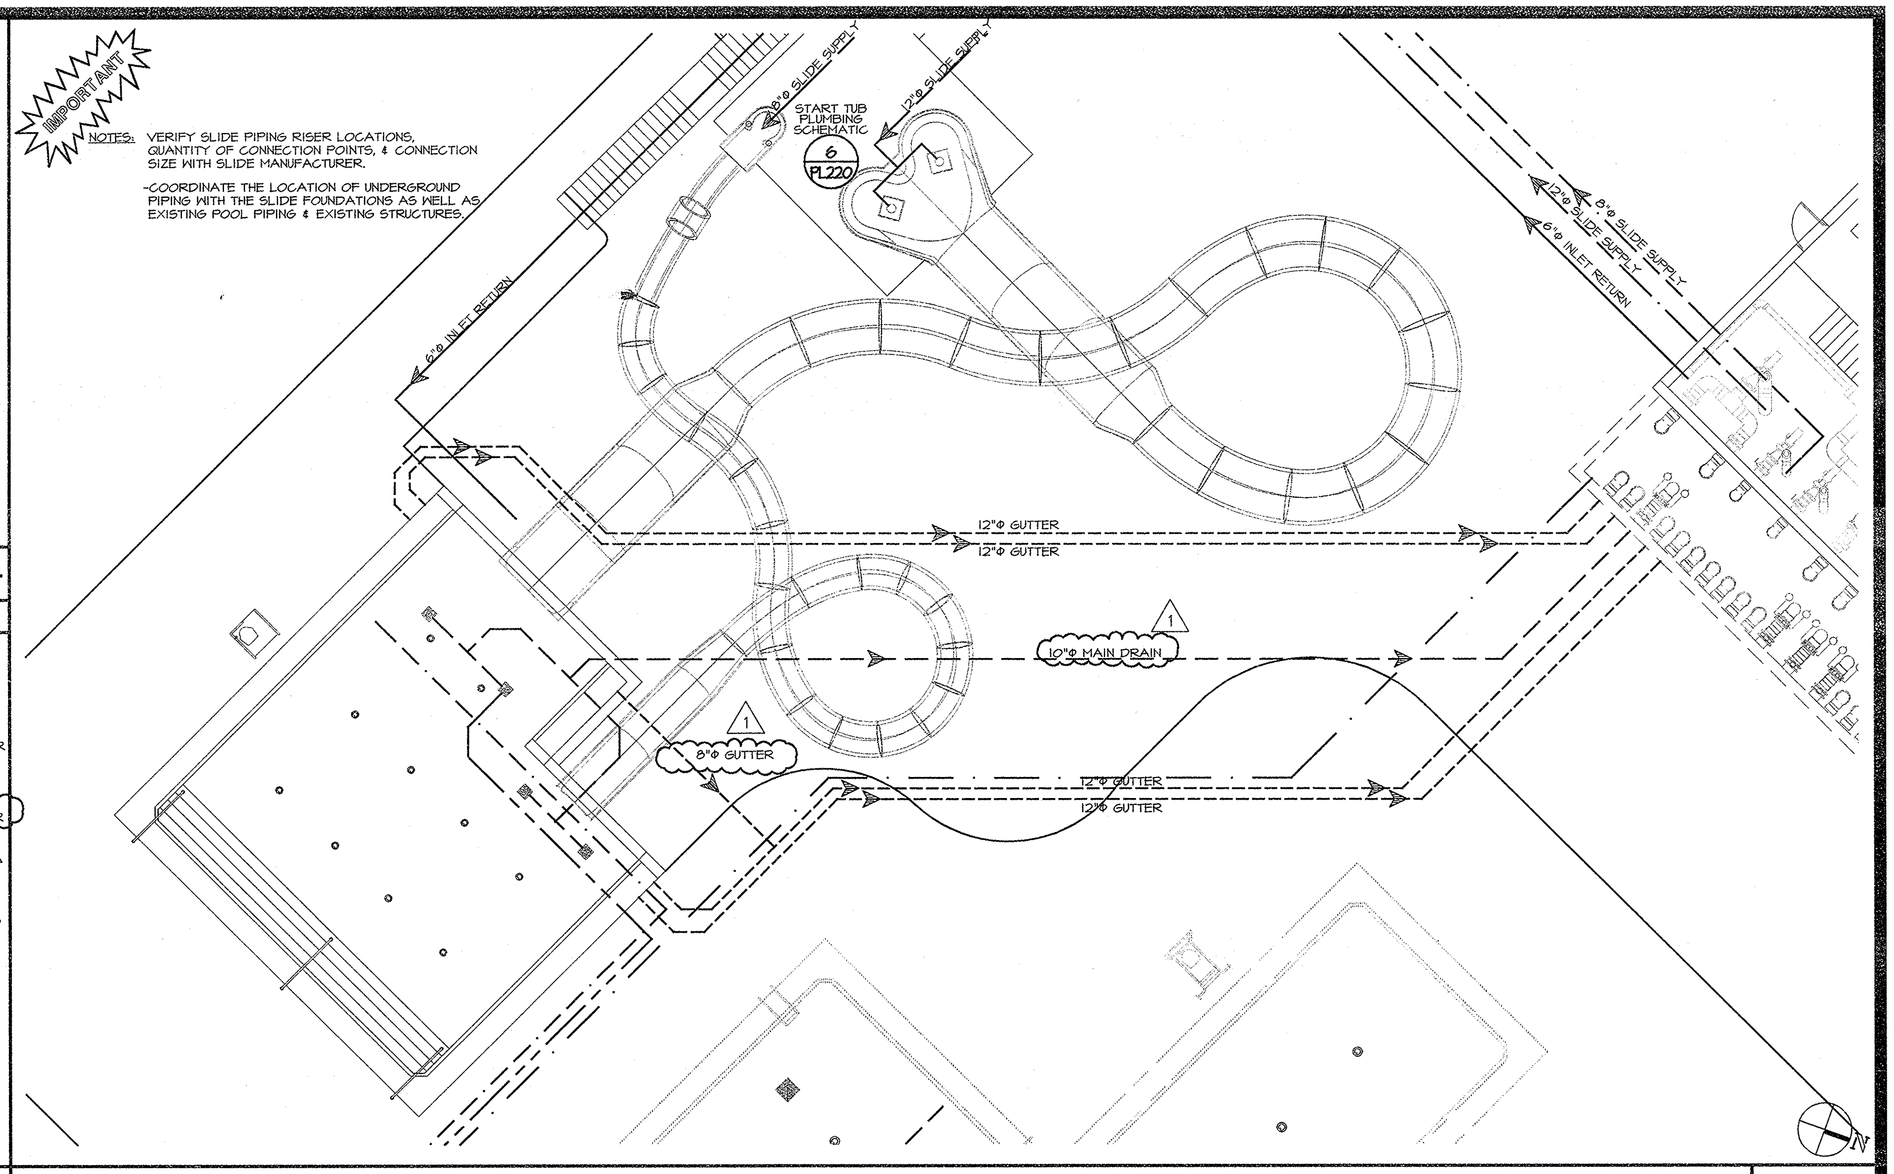

PLUNGE POOL SITE PIPING PLAN — PL220-1

FOR SCHEMATIC USE ONLY ! DO NOT SCALE DRAWING.

SCALE: 1/8"=1'-0"

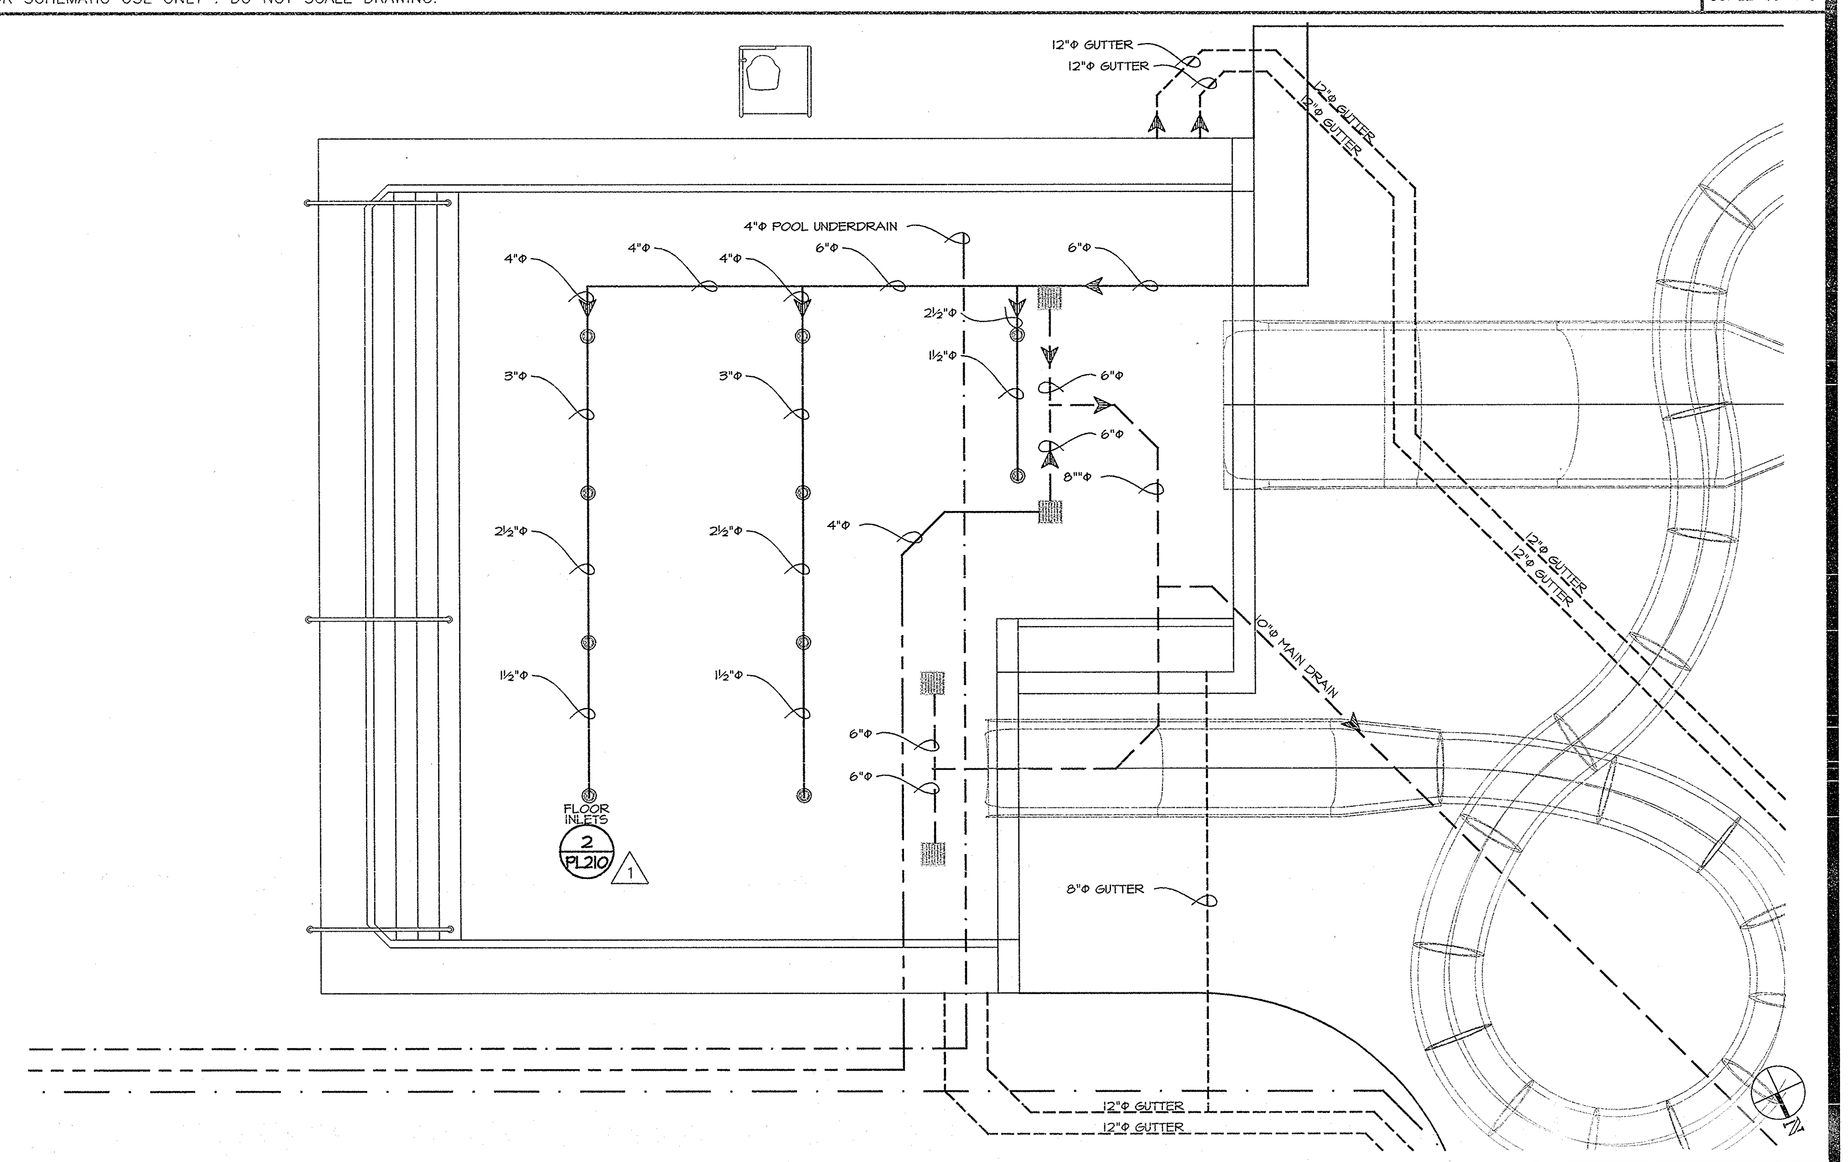

PLUNGE POOL PIPING PLAN — PL220-2

FOR SCHEMATIC USE ONLY ! DO NOT SCALE DRAWING.

SCALE: 1/4"=1'-0"

GRAEF ANHALT SCHLOEMER and Associates Inc.

345 North 95th Street
Milwaukee, Wisconsin 53226
414 259-1500
FAX 259-0037

Other Offices Located in:

Green Bay, Wisconsin
Madison, Wisconsin
Chicago, Illinois
Colorado Springs, Colorado

WATER TECHNOLOGY, INC.
Aquatic Designers and Engineers
Atlanta, GA • Beaver Dam, WI • Cedar Rapids, IA
P.O. Box 614 / W8696 Beaverland Parkway
Beaver Dam, Wisconsin 53916
Voice: 414-887-7373 Fax: 414-887-7929

©Copyright WATER TECHNOLOGY, INC. 1995

This Document and the ideas, renderings and other contents contain therein are the sole property of Water Technology, Inc. and may not be disseminated, copied, reproduced or otherwise used without prior written consent of Water Technology, Inc.

WTI PROJECT # 95023

PROJECT NAME:
GREENFIELD AQUATIC CENTER

SHEET TITLE:
PLUNGE POOL PIPING PLAN AND NOTES

NO.	DATE	REVISIONS	BY
2	01/02/96	REISSUED	SMF
1	07/10/95	ADDENDUM #1	SMF

PROJECT NUMBER:
DATE: 01/02/96
DRAWN BY: SMF
CHECKED BY: DGM
PROJECT MANAGER: DGM
FILE NAME:

SHEET NUMBER
PL220

4/2/95

13-A17-218

P-14-4-36